


GRAMA SACHIVALAYAM


29'



40'-9"

GODOWN
28'-0" X 11'-0"

Shutter

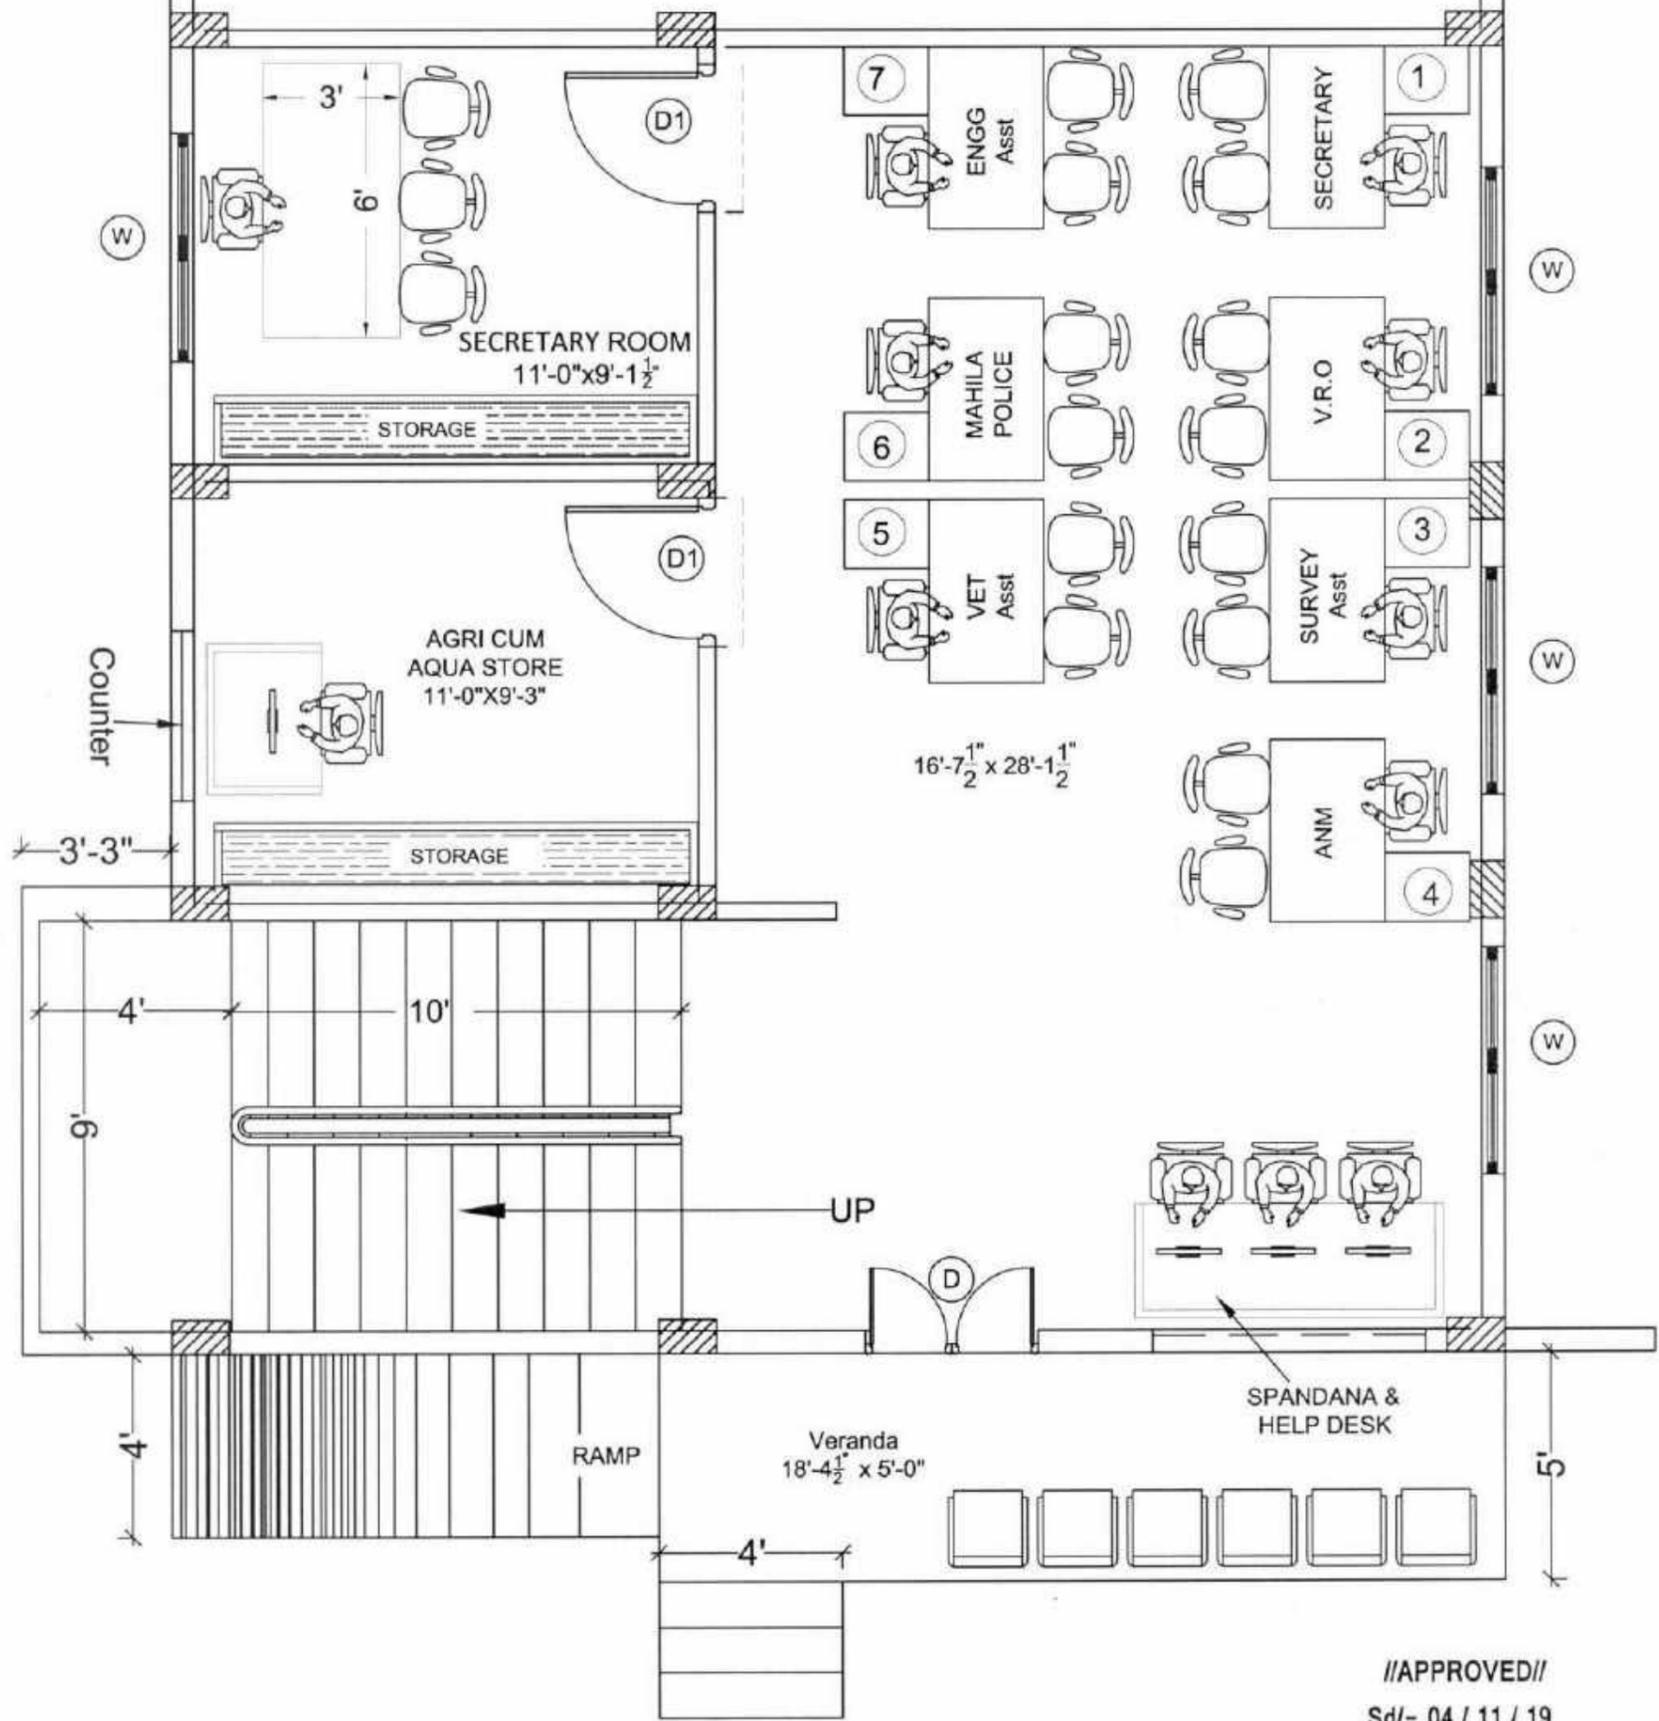

GROUND FLOOR PLAN

//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

SCHEDULE OF OPENINGS :	
MAIN DOOR D	= 1.20 X 2.10
DOOR D1	= 1.05 X 2.10
DOOR D2	= 0.76 X 2.10


// TRUE COPY //

[Signature]
Dy. Executive Engineer, PR (Designs)

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	GROUND FLOOR PLAN
Drg.No :	PR / Grama Sachivalayam / AR / 01
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

[Handwritten]
27/4/19

GRAMA SACHIVALAYAM

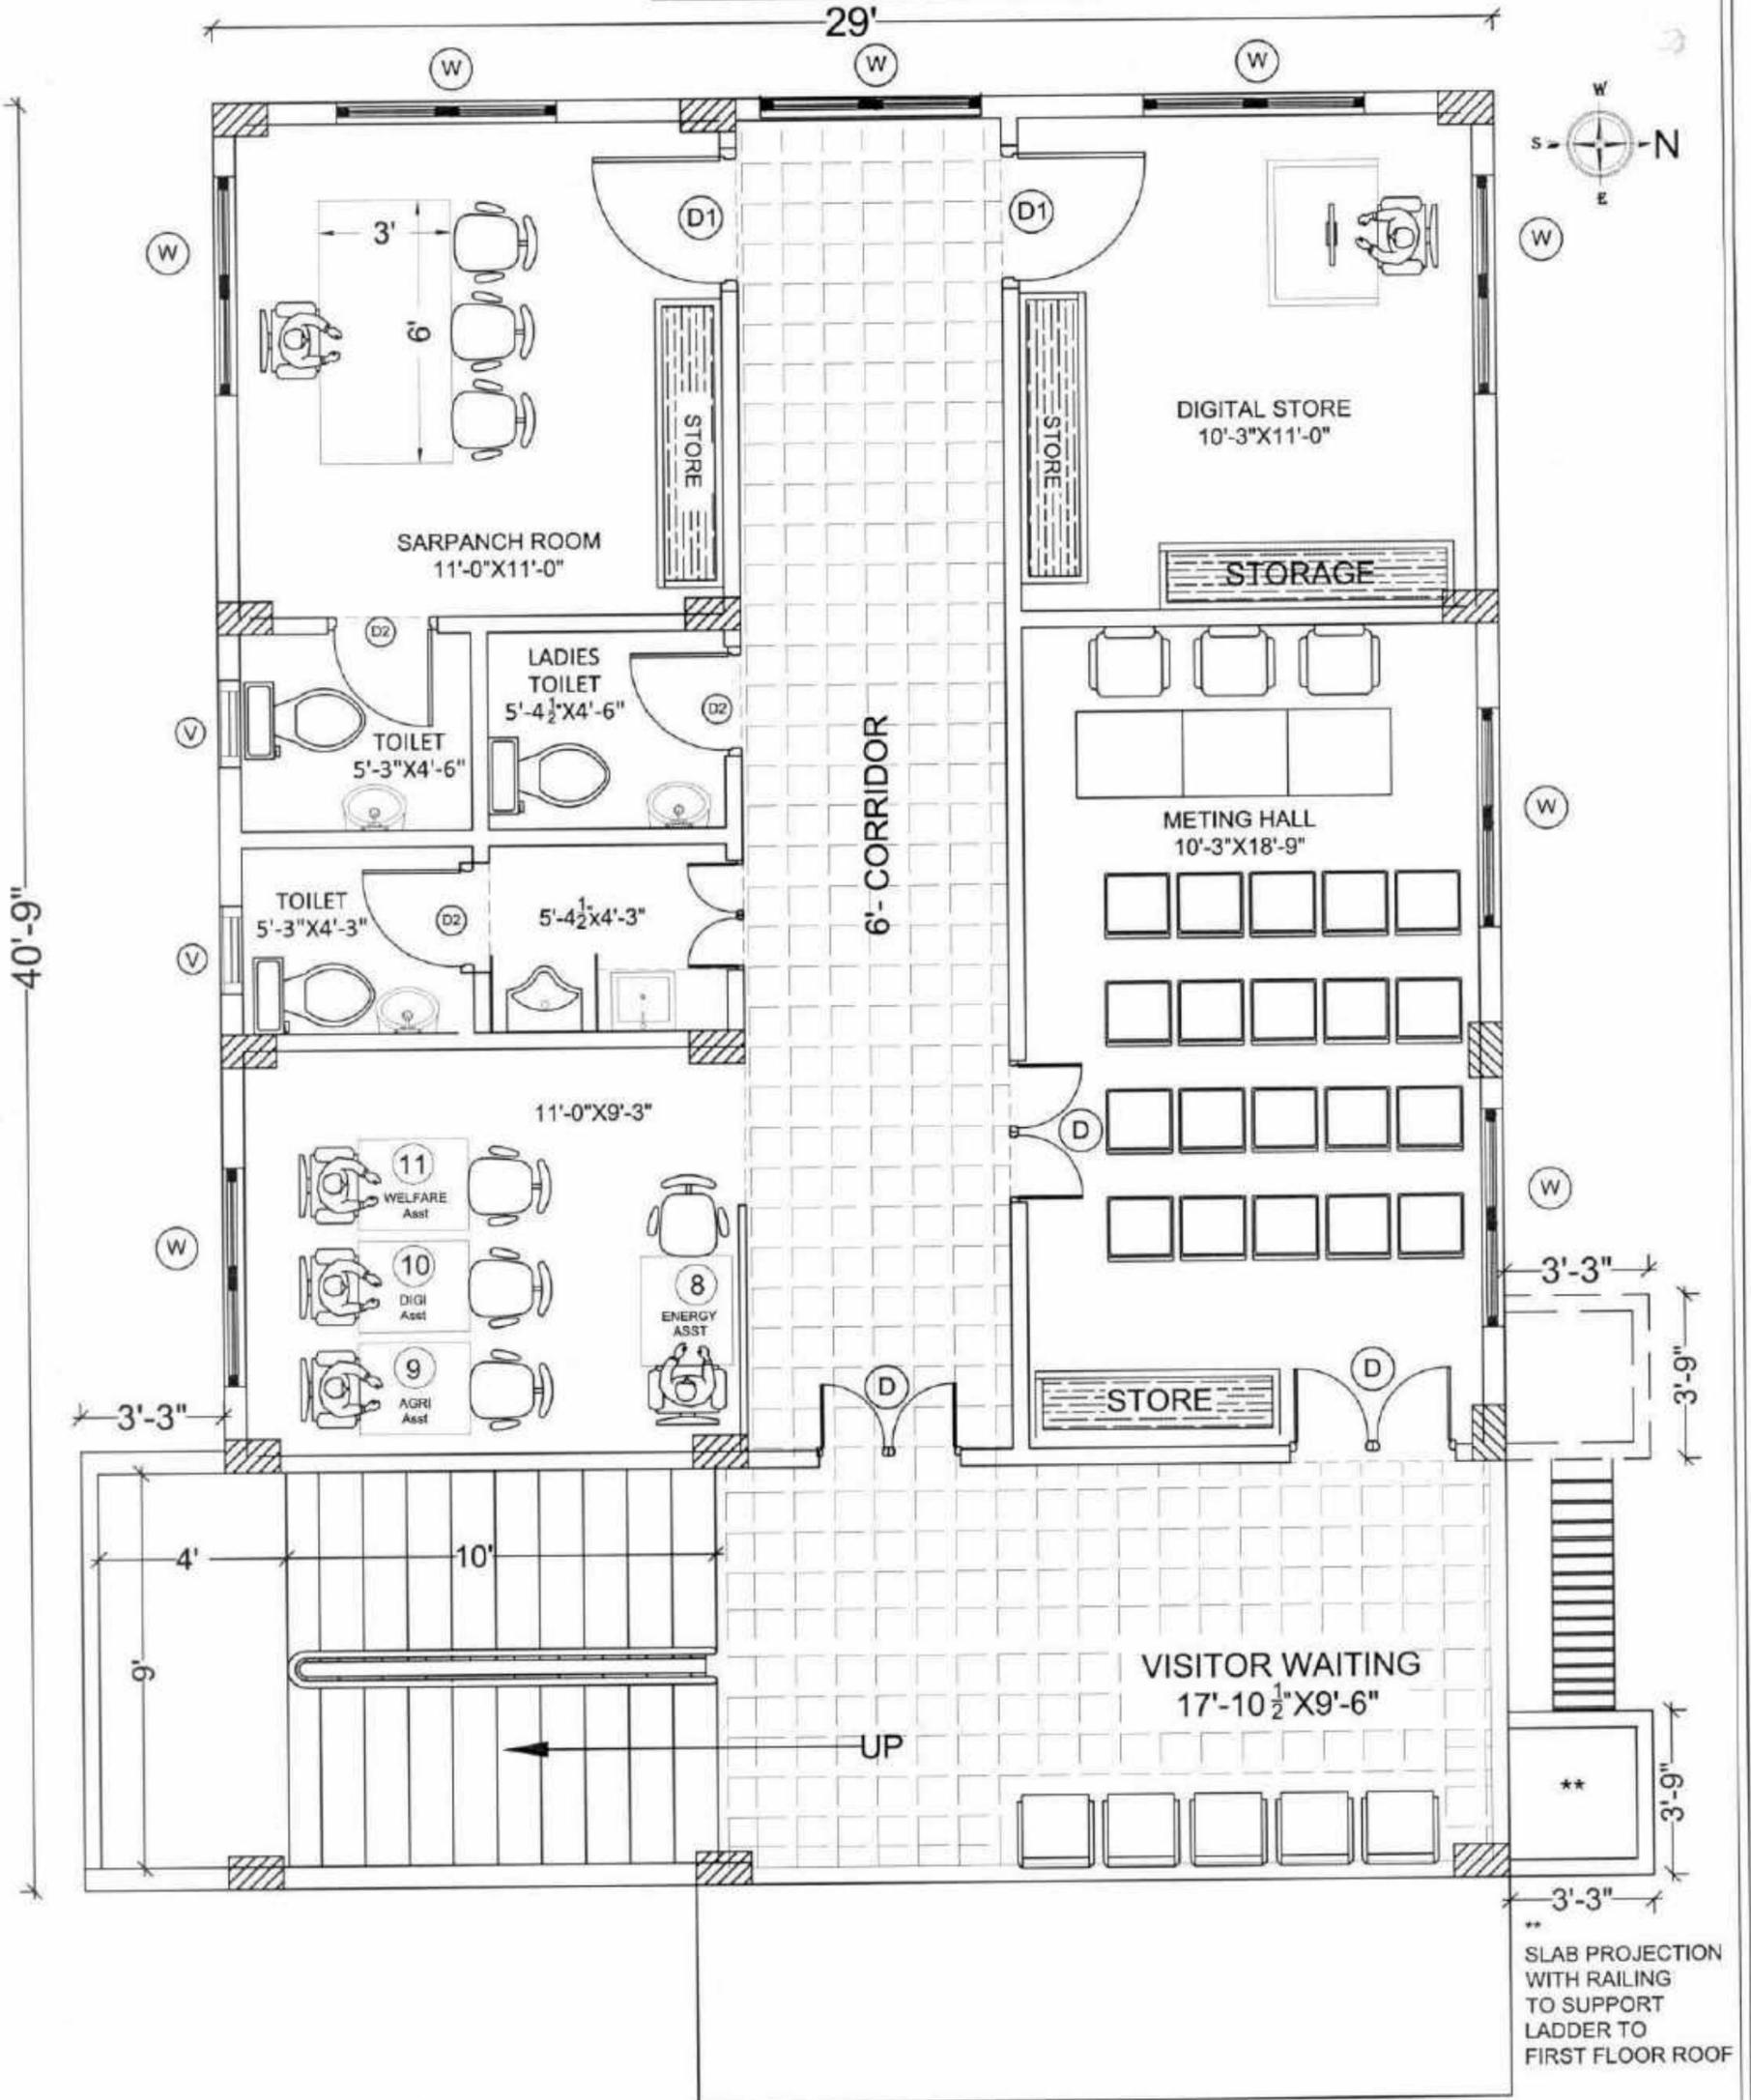

FIRST FLOOR PLAN

//APPROVED//

Sd/- 04 / 11 / 19

Chief Engineer, PR II
Vijayawada.


SCHEDULE OF OPENINGS :	
MAIN DOOR D	= 1.20 X 2.10
DOOR D1	= 1.05 X 2.10
DOOR D2	= 0.76 X 2.10

// TRUE COPY //

Dy. Executive Engineer, PR (Designs)

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	FIRST FLOOR PLAN
Drg.No :	PR / Grama Sachivalayam / AR / 02
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

GRAMA SACHIVALAYAM

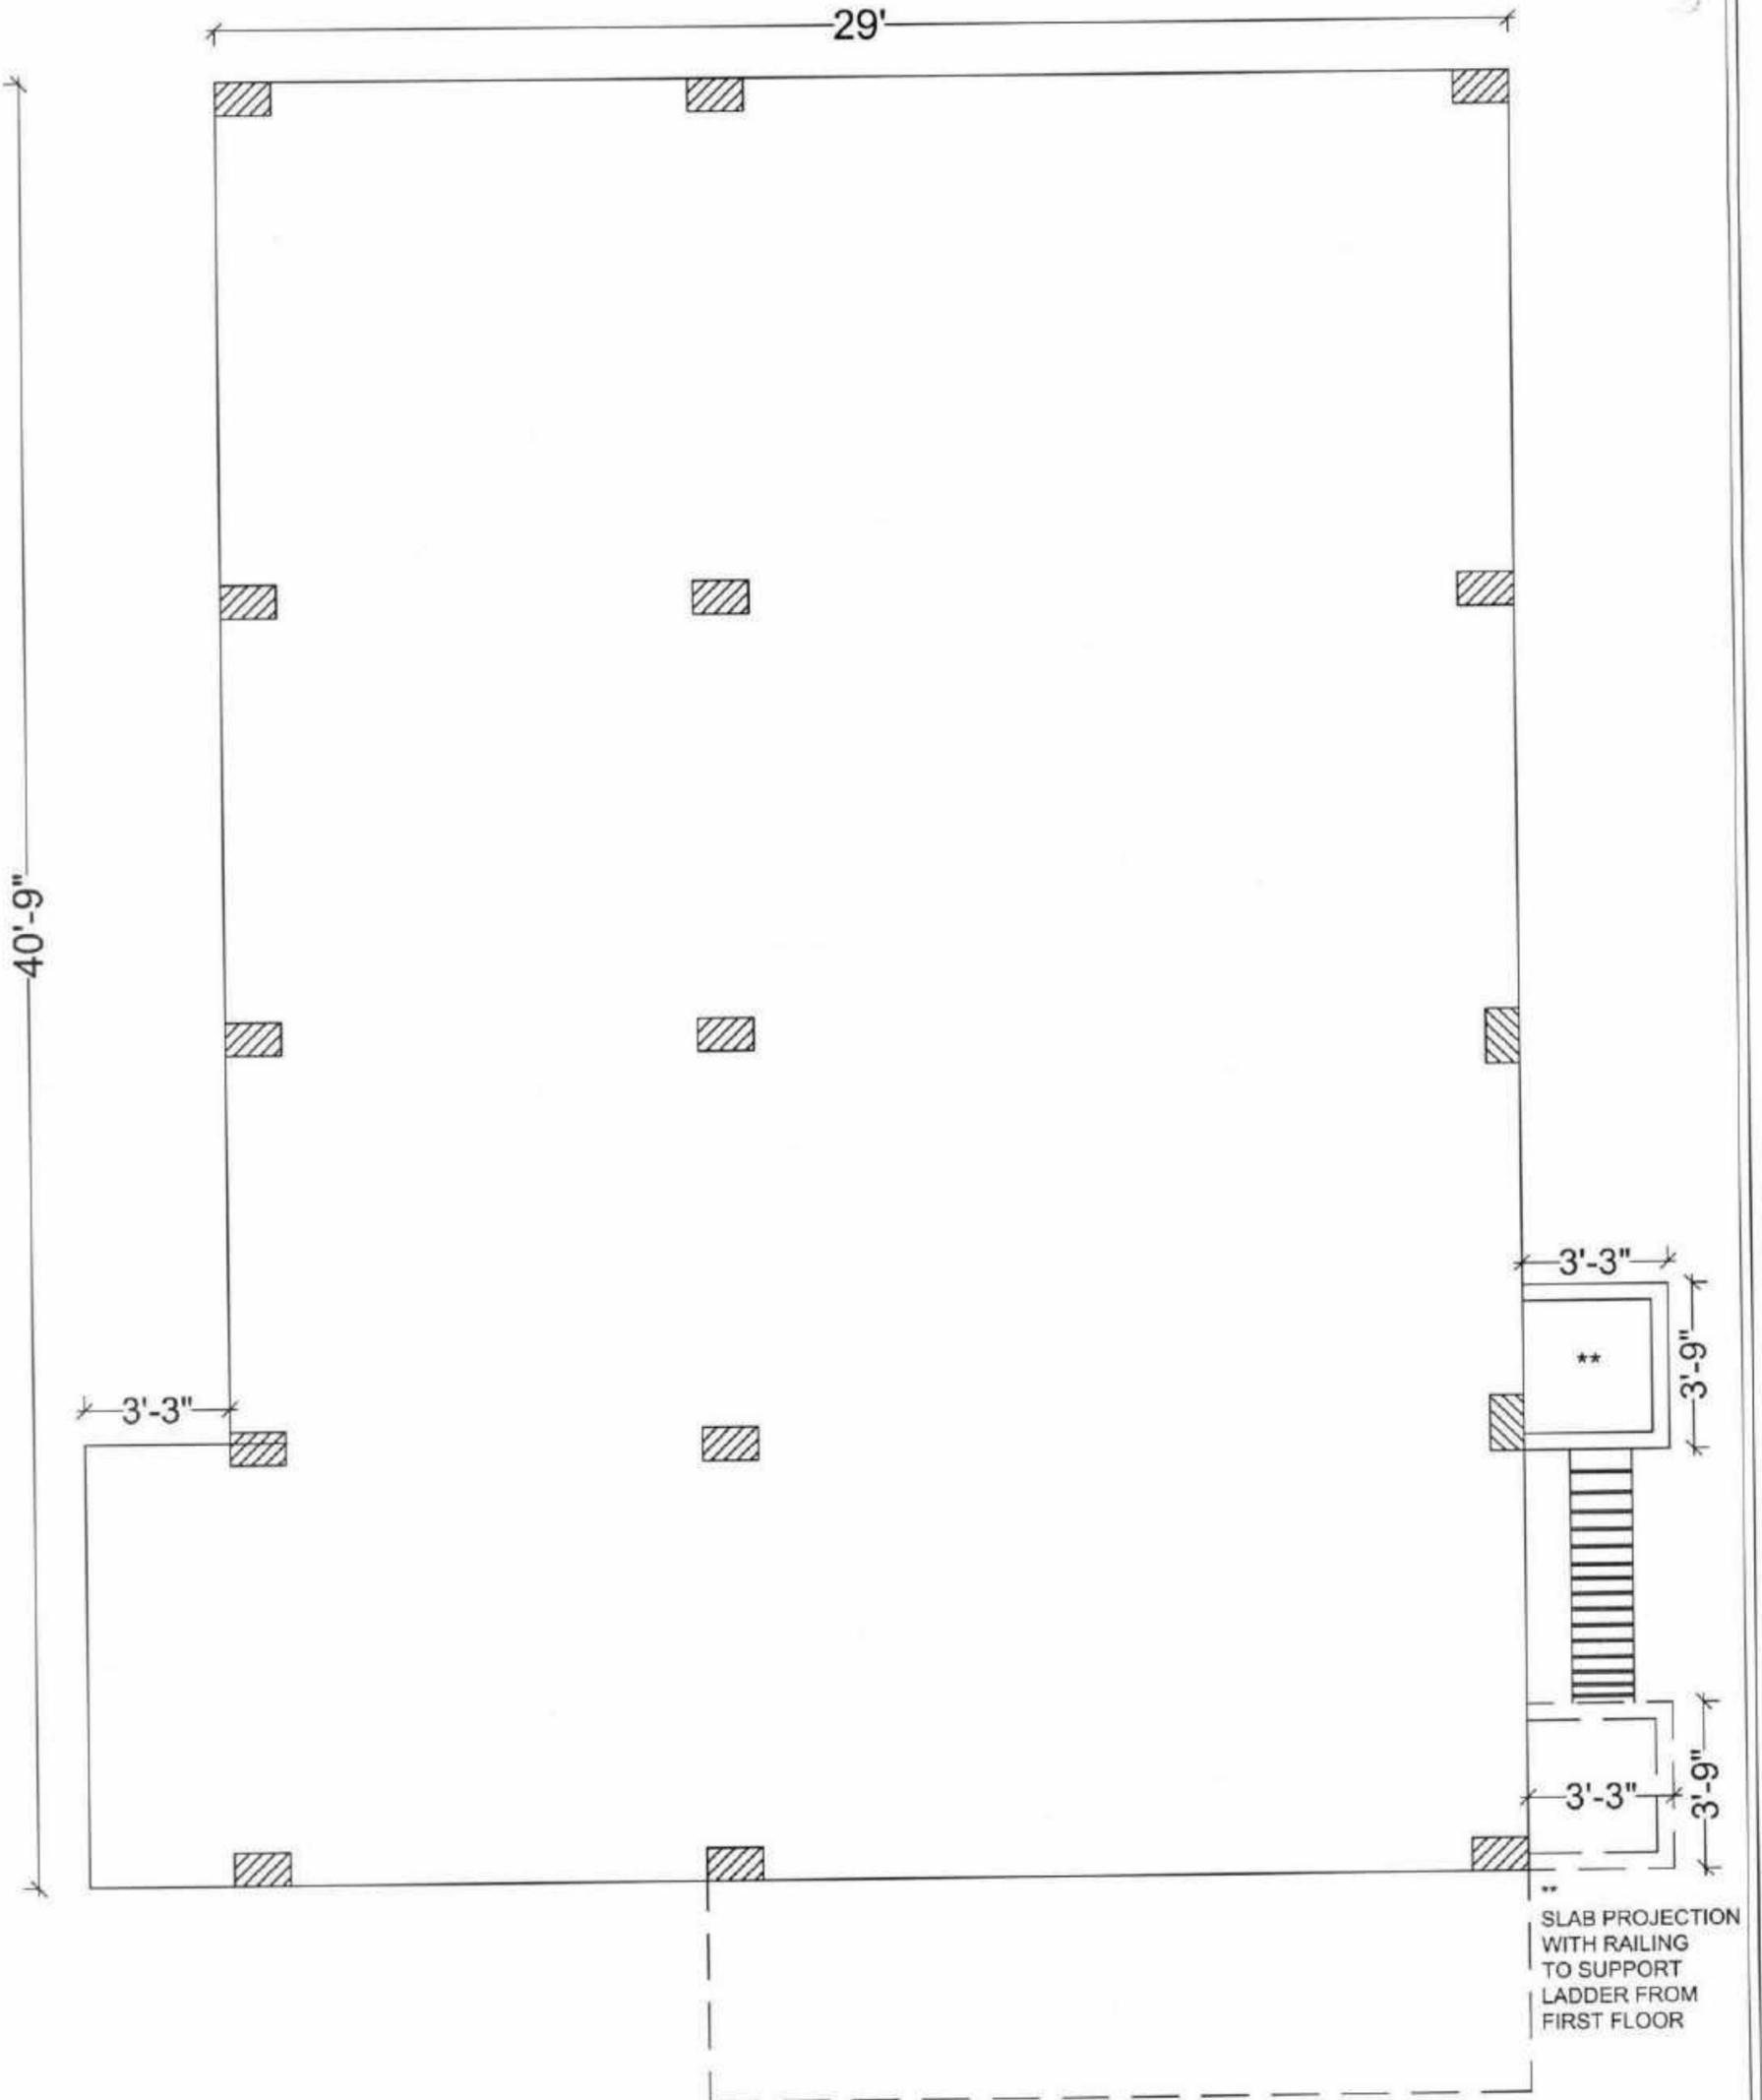

TERRACE FLOOR PLAN

//APPROVED//

Sd/- 04 / 11 / 19

Chief Engineer, PR II
Vijayawada.

// TRUE COPY //

[Signature]
Dy. Executive Engineer, PR (Designs)

[Signature]
4/11/19

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	TERRACE FLOOR PLAN
Drg.No :	PR / Grama Sachivalayam / AR / 03
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

NOTES:

- DO NOT SCALE THIS DRAWING. FOLLOW FIGURED DIMENSIONS ONLY.
- ALL DIMENSIONS ARE IN MM ONLY AND LEVELS ARE IN METERS UNLESS SPECIFIED.
- S.B.C OF SOIL IS CONSIDERED AS $\frac{100}{150/200}$ KN/M² AT A DEPTH OF _____M. AS RECOMMENDED AND SHOULD ENSURE THE SBC AT ALL FOOTINGS BEFORE EXECUTION.
- USE VIBRATED REINFORCED CONCRETE CONFIRMING TO IS : 456-2000. THE GRADES FOR DIFFERENT COMPONENTS ARE AS FOLLOWS

Component	Footing	Pedestal & Columns	Beams	Slabs
Mix	M30	M30	M30	M30


- GRADE OF STEEL SHALL BE Fe500. EXCEPT WHEREVER INDICATED.
* IT SHOULD BE ENSURED THAT THE ABOVE STEEL IS PRODUCED BY THERMOMECHANICAL TREATMENT PROCESS, HAVING ELONGATION MORE THAN 14.5% AND CONFIRMING TO IS 1786-85 & ITS AMENDMENTS
- CONCRETE LAID IN THE FORM WORK SHALL INVARIABLY VIBRATED TO OBTAIN MAX. DENSITY AND COMPACTION.
- PROVISIONS MADE IN IS 456-2000, ANDSP 34 AND OTHER RELEVANT CODES SHOULD BE STRICTLY ADHERED TO, DURING EXECUTION.
- LAPS SHALL BE STAGGERED AND LAP LENGTHS ARE AS FOLLOWS.

Mix	M30
Ld	48 Dia Tension/ 37 Dia Compression


- NOT MORE THAN 50% OF COLUMN REINFORCEMENT SHALL BE LAPPED AT A PARTICULAR LOCATION.
- CLEAR COVERS ARE AS FOLLOWS

FOOTING TO MAIN BAR	PEDESTAL TO MAIN BAR	COLUMN TO MAIN BAR	BEAMS	SLABS & STAIR CASE TO MAIN BAR
50mm	50mm	50mm	35mm	30mm

- ANY LOOSE OR PROTRUDING BOULDERS SHALL BE REMOVED BEFORE LAYING FOUNDATION CONCRETE AND SHALL BE FILLED WITH PCC (1:4:8).
- WHEREVER NECESSARY DRILLING SHALL BE RESORTED TO, IN HARD SHEET ROCK ONLY.
- STIRRUPS SHOULD HAVE STANDARD HOOK AS PER SP-34
- EXTRA BARS AT TOP FOR BEAM SHALL BE EXTENDED UPTO 0.25L ON EITHER SIDE FROM THE FACE OF EDGE MEASURED FROM CENTER OF SUPPORT. WHERE 'L' IS c/c OF SUPPORTS. THE CURTAILMENT OF BOTTOM BARS AT 0.1 L FROM DISCONTINUOUS EDGE AND 0.15 L FROM CONTINUOUS EDGE.

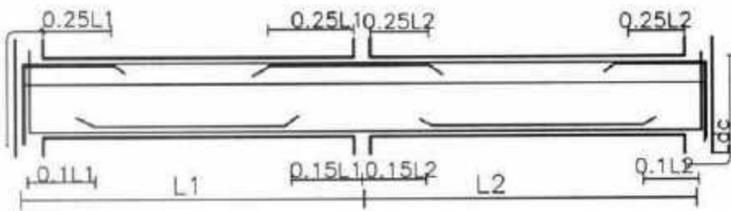


TYPICAL DETAILS OF A BEAM

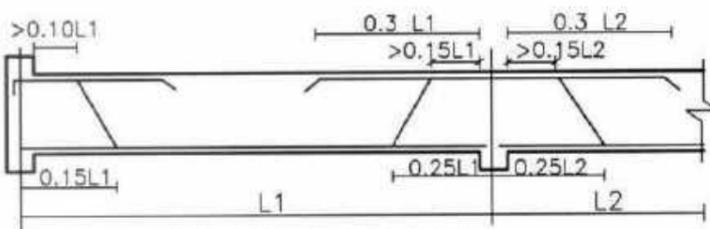

TYPICAL DETAILS OF A SLAB

- SLAB BARS ARE TO BE CRANKED AT 0.25 L FROM CENTRE OF SUPPORT NEAR CONTINUOUS EDGES AND 0.15 L FROM CENTRE OF SUPPORT NEAR DISCONTINUOUS EDGES.
- IN SLABS EXTRA BARS OVER CONTINUOUS SUPPORT SHOULD BE TAKEN UPTO 0.3L FROM THE FACE OF BEAM. CRANK BARS AT CONTINUOUS SUPPORT SHOULD NOT BE TERMINATED ON BEAM AND SHOULD BE EXTENDED UPTO 0.3L FROM FACE OF SUPPORT INTO THE ADJACENT SPAN.
- DISTRIBUTION STEEL IN SLAB FOR CRANKED BARS AND TOP EXTRA BARS SHALL BE 8 TOR @ 200 C/C
- THE REINFORCEMENT SHALL BE CHECKED BEFORE LAYING CONCRETE.
- WHEREVER, THE SECONDARY BEAM RESTS ON MAIN BEAM THE ARRANGEMENT OF BENT UP HANGER BARS SHALL BE PROVIDED AS GIVEN BELOW:

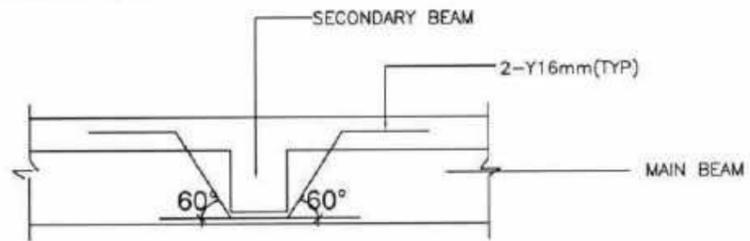

- IN BEAMS & SLABS, OVERLAPPING SHALL NOT BE PROVIDED OVER SUPPORTS FOR TOP BARS AND AT MID SPAN FOR BOTTOM BARS.
- WHEREVER REINFORCEMENT IS PROVIDED IN TWO LAYERS IN BEAMS SPACER BAR SHALL BE PROVIDED TO MAINTAIN 25MM GAP OR MAXIMUM DIA OF MAIN BAR, WHICH EVER IS MORE, BETWEEN TWO LAYERS.
- WHEN SPAN IS MORE THAN 6.0M PROVIDE A CAMBER OF SPAN/250 FOR BEAMS & SLABS.
- THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH RELEVANT ARCHITECTURAL DRAWINGS.
- THIS BUILDING IS DESIGNED FOR G.F+1 STOREYS AND FOR BASIC WIND SPEED 50 m/s AND FOR SEISMIC ZONE -II
- FLOOR TO FLOOR HEIGHT IS CONSIDERED AS 3.30m
- CURING SHOULD BE DONE AT LEAST FOR 21 DAYS
- STRIPPING TIME OF FORMWORK SHALL CONFORM TO CLAUSE 11.3 OF IS 456-2000

LEGEND:

- FFL : Finished Floor Level.
- FGL : Finished Ground Level
- TOB : Top of beam
- SFL : Structural finished Level

//APPROVED//

Sd/- 04 / 11 / 19

Chief Engineer, PR II
Vijayawada.

// TRUE COPY //

Dy. Executive Engineer, PR (Designs)


IMPORTANT NOTE:

- THE RESPONSIBILITY FOR FIXING OF F.G.L AND .F.L ARE LIES WITH THE SE/E.E CONCERNED.
- PRIOR PERMISSION FOR ANY DEVIATION AND FINANCIAL IMPLICATIONS HAVE TO BE OBTAINED BEFORE EXECUTION OF WORK.
- BEFORE COMMENCEMENT OF WORK STRUCTURAL DRAWINGS SHALL HAVE TO BE VARIFIED WITH RESPECT TO THE APPROVED ARCHITECTURAL DRAWING.
- ANY ITEM OF WORK FOR WHICH STRUCTURAL DRAWINGS ARE COMMUNICATED BUT ARE NOT INCLUDED IN AGREEMENT PRIOR APPROVAL SHALL BE TAKEN FROM COMPETENT AUTHORITY BEFORE GROUNDING OF SUCH WORK.
- IF ANY VARIATION IS FOUND IN THE FOUNDATION SOIL WITH REFERENCE TO THE SBC AND SPECIFICATIONS OF SOIL IN THE DESIGNS OF FOUNDATIONS, THE SUPERINTENDING ENGINEER IS REQUESTED TO REPORT THE SAME TO THIS OFFICE FOR REVISION OF FOOTING DESIGNS.

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	GENERAL NOTES
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / GEN / 01
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

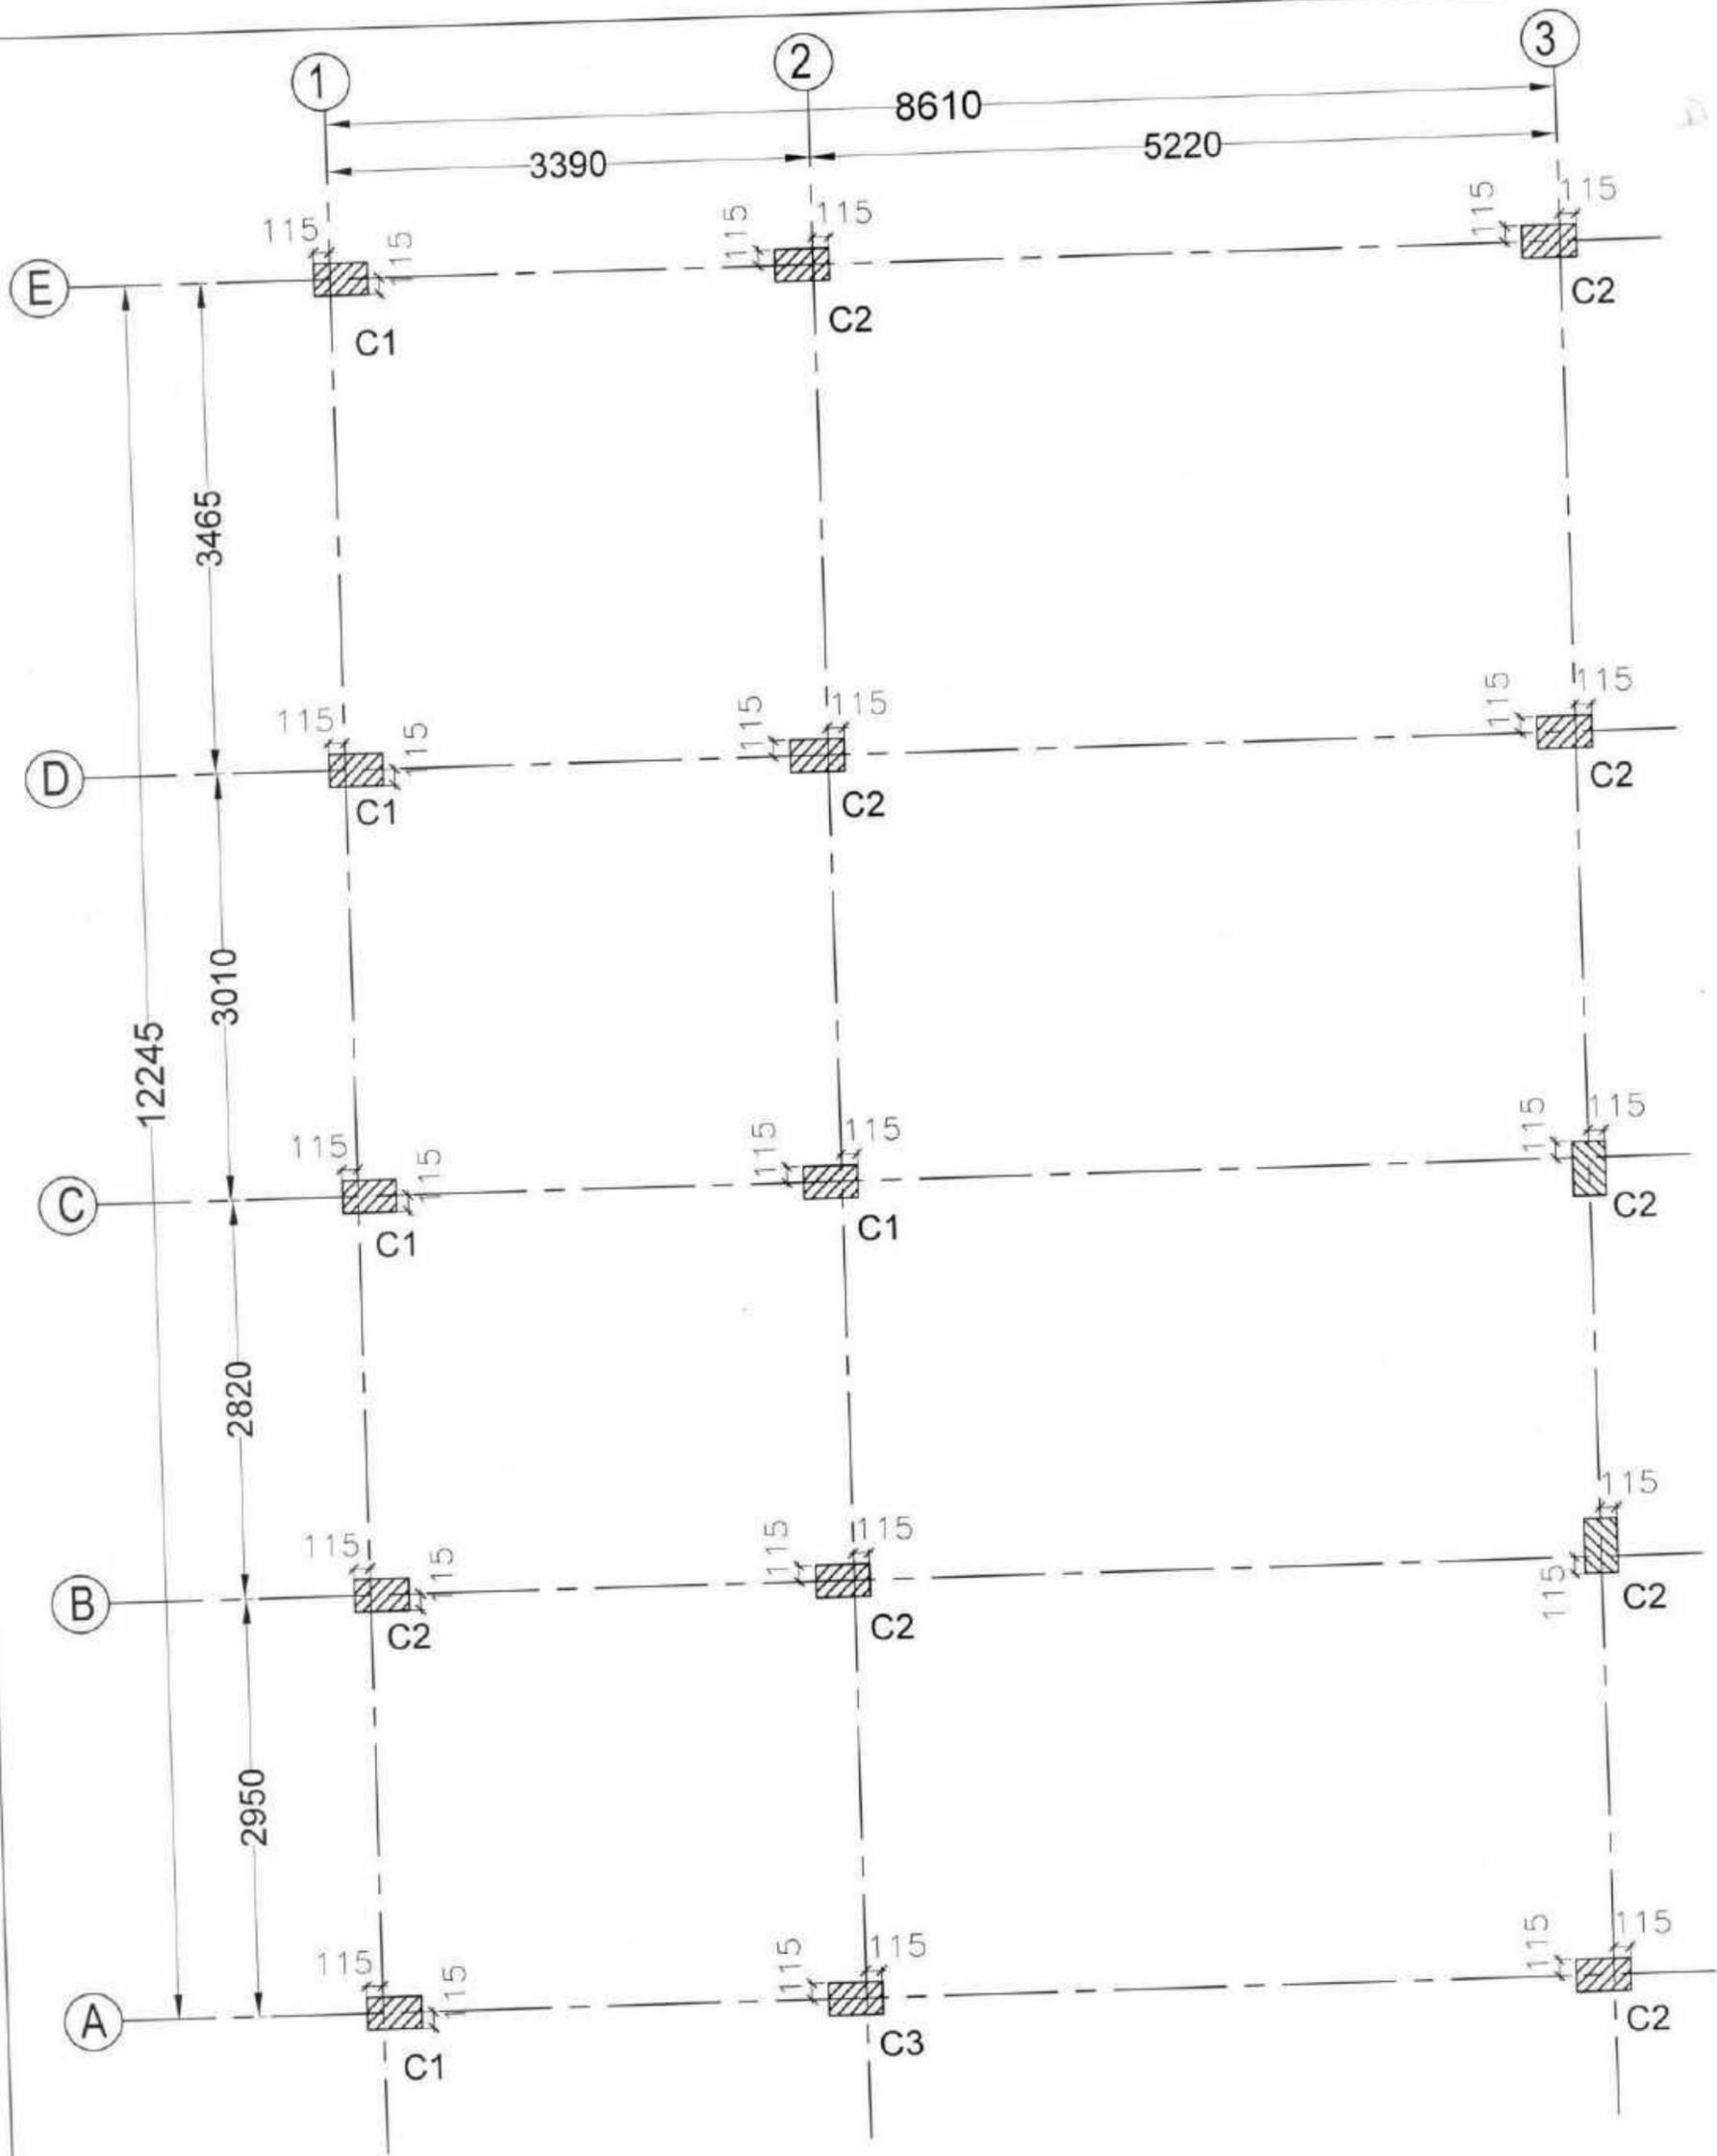

COLUMN CENTER LINE LAYOUT

//APPROVED//

Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

// TRUE COPY //

[Signature] 4-11/19
Dy. Executive Engineer, PR (Designs)

Radial Distance Upto 50 Km From Coast line


Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

NAME OF WORK :
CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING

Drg. Title : COLUMN CENTER LINE LAYOUT

Drg.No : PR / Grama Sachivalayam / Z II / M30 / SD / 01

PANCHAYATI RAJ ENGINEERING DEPARTMENT
VIJAYAWADA.

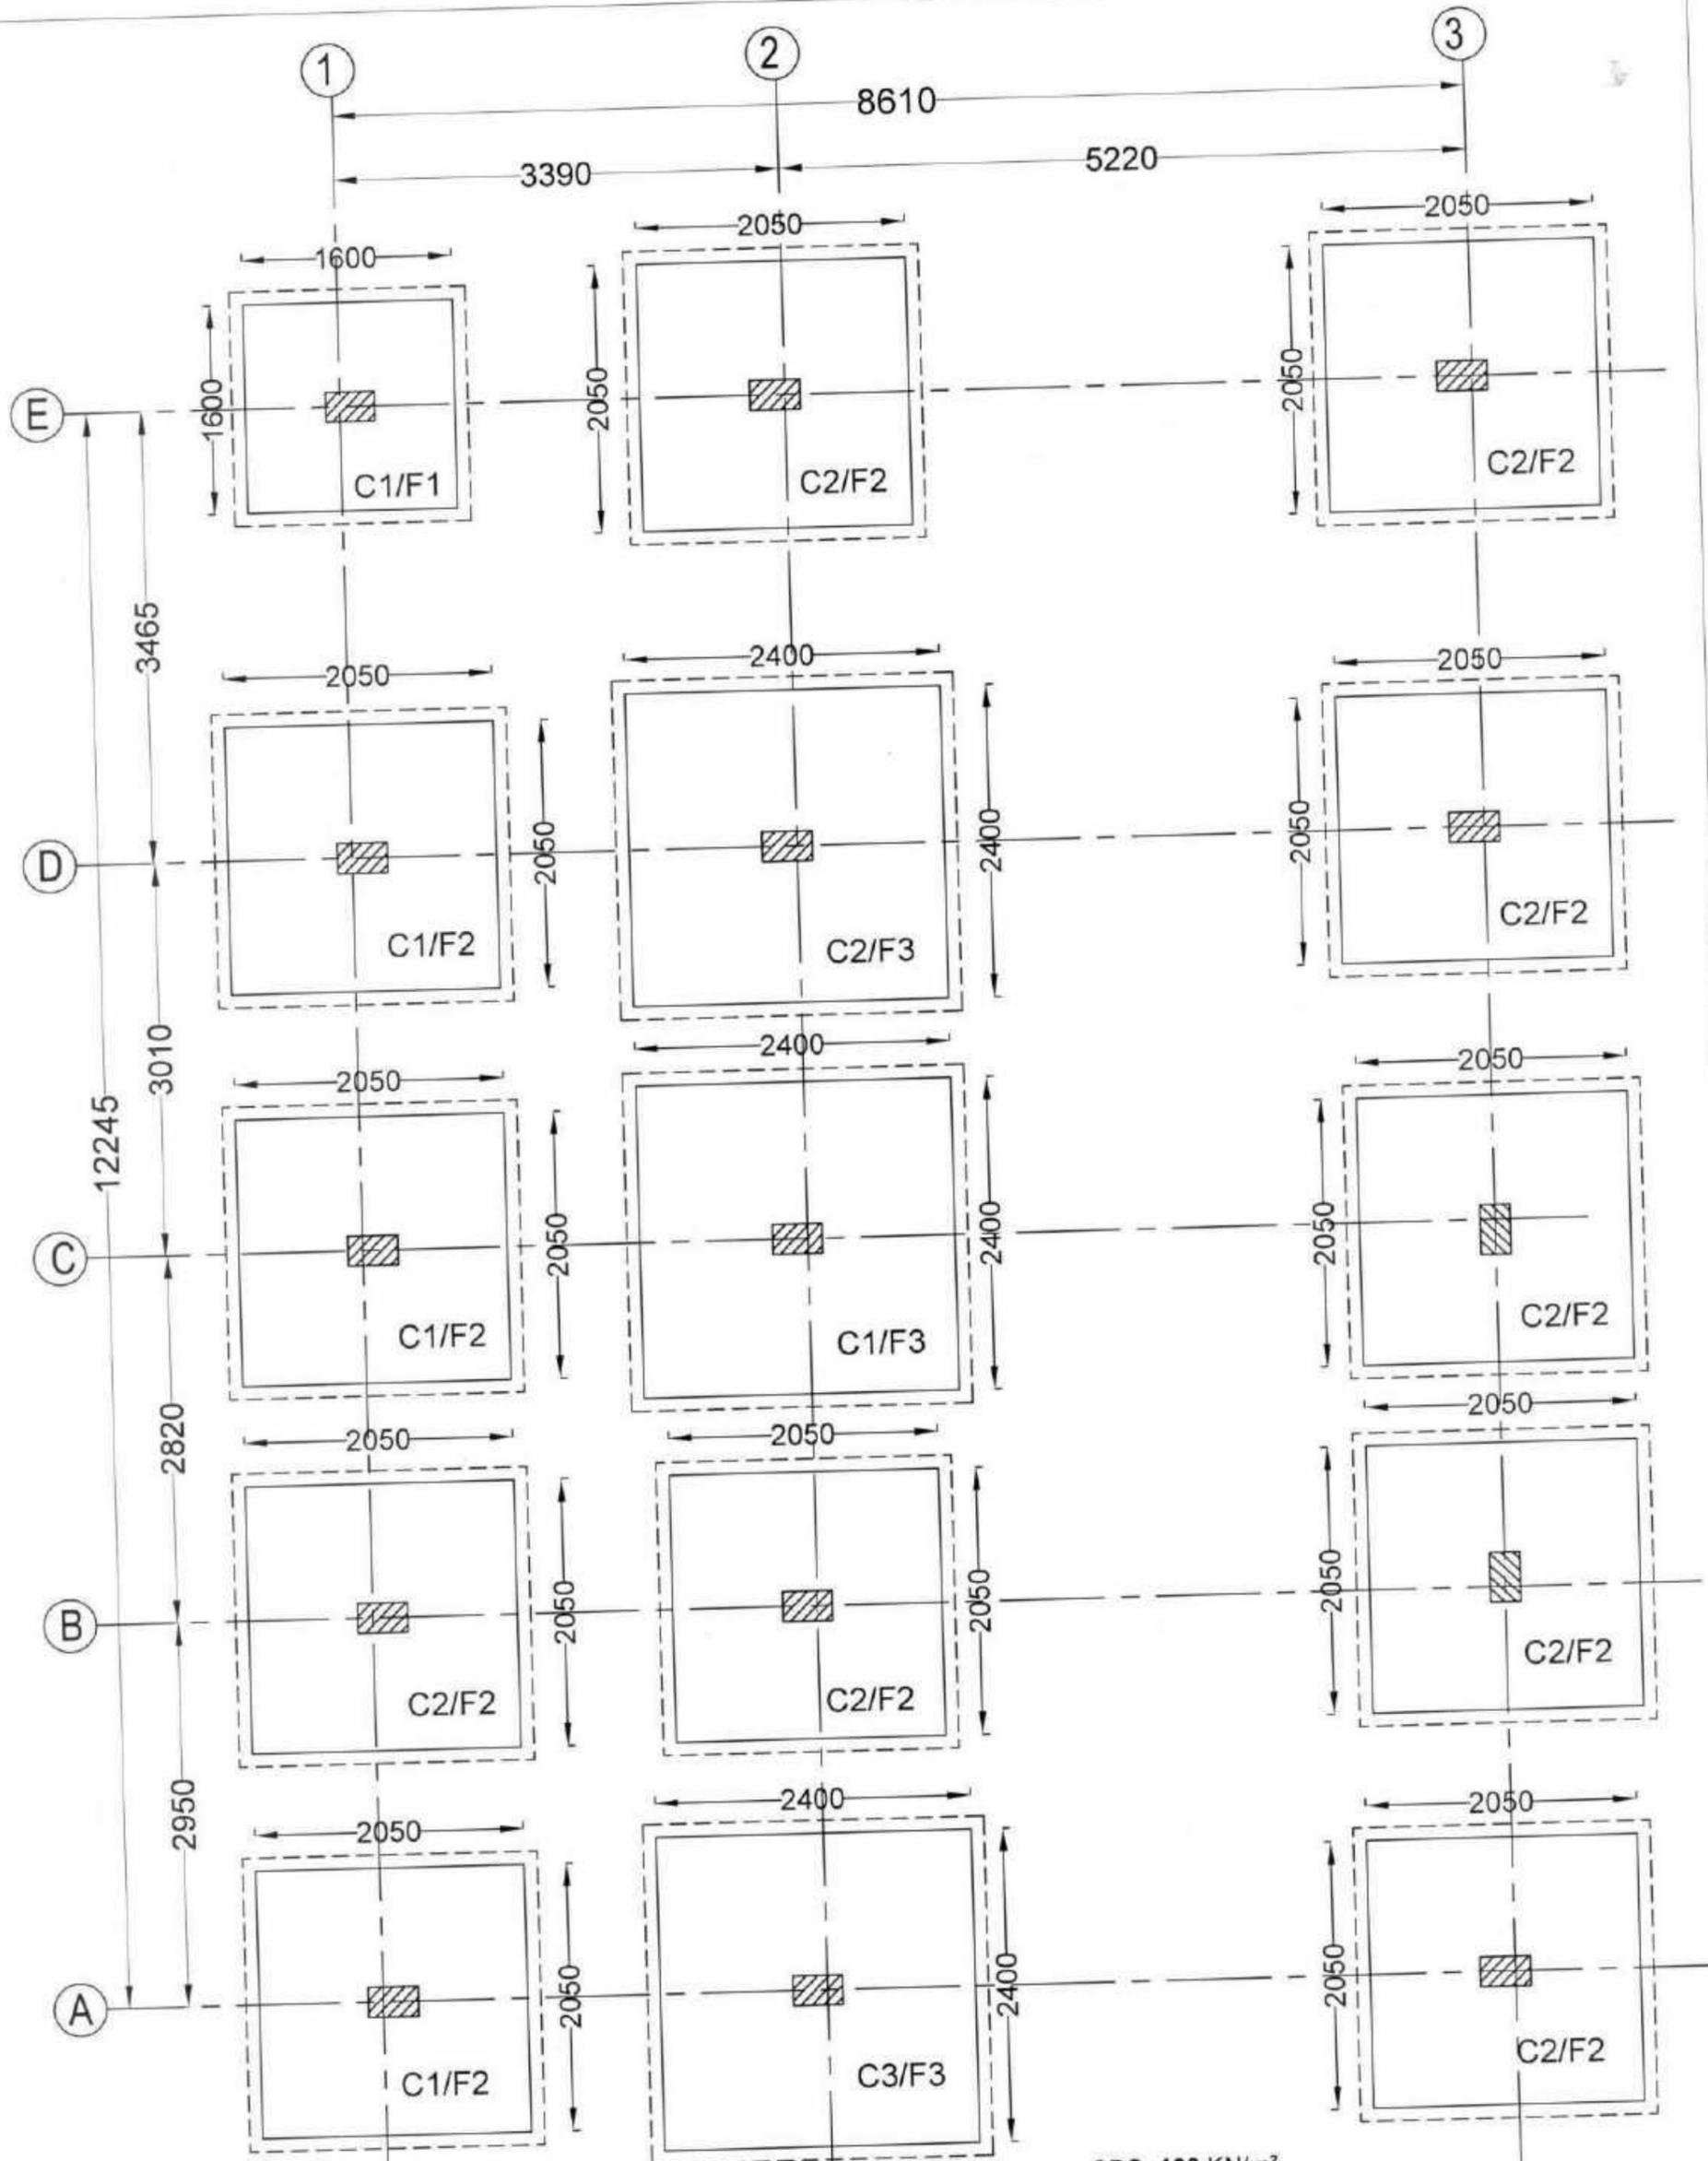

COLUMN & FOOTING LAYOUT

SBC -100 KN/m²

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer,PR ii
Vijayawada.

// TRUE COPY //


Dy. Executive Engineer,PR (Designs)

24/11/19

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	COLUMN & FOOTING LAYOUT
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 2A
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	


SCHEDULE OF COLUMNS

COLUMN GROUP	COLUMN SIZE	Reinforcement up to 1st Floor	SECTION
C1	230 x 380	●8-#12mm	<p>1 TIE+2 links</p>
C2	230 x 380	●4-#16mm ○4-#12mm	<p>1 TIE+2 links</p>
C3	230 x 380	●8-#16mm	<p>1 TIE+2 links</p>

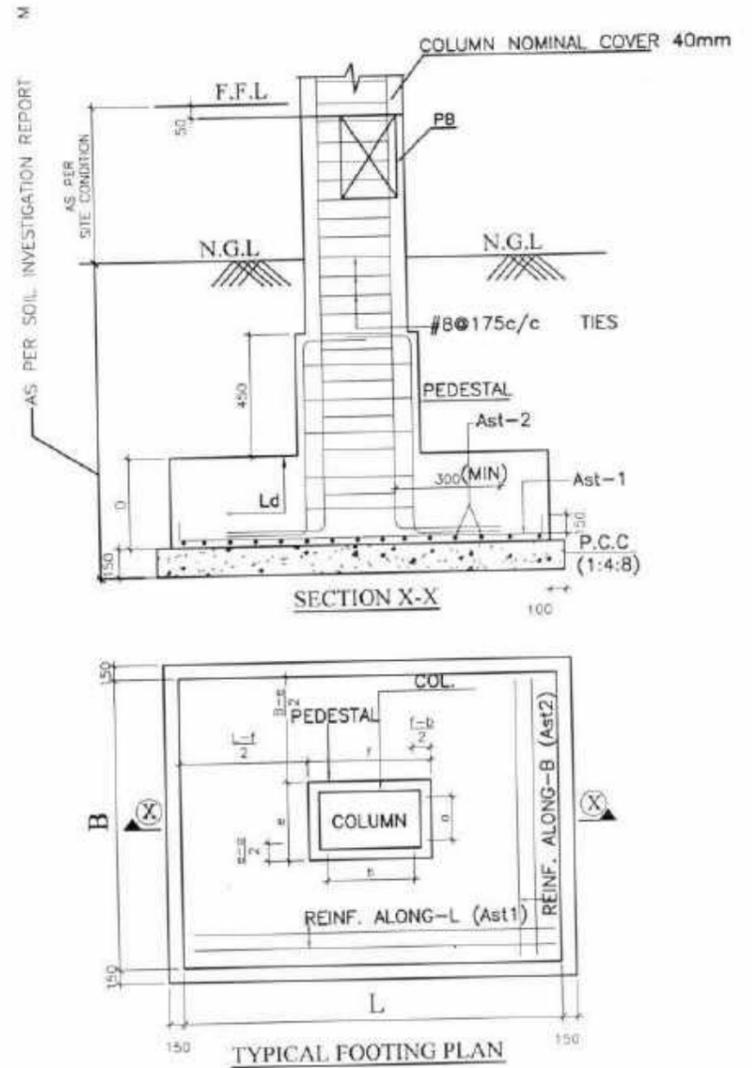

SCHEDULE OF FOOTINGS FOR SBC -100 KN/m²

Footing Group	Mix	Footing Size mm L x B	Depth mm	Bottom Reinforcement	
				REINFORCEMENT ALONG-L (Ast1)	REINFORCEMENT ALONG-B (Ast2)
F1	M30	1600 x 1600	300	Y 10- 9 Nos	Y 10- 9 Nos
F2	M30	2050 x 2050	350	Y 12- 12 Nos	Y 12- 12 Nos
F3	M30	2400 x 2400	425	Y 12- 16 Nos	Y 12- 16 Nos

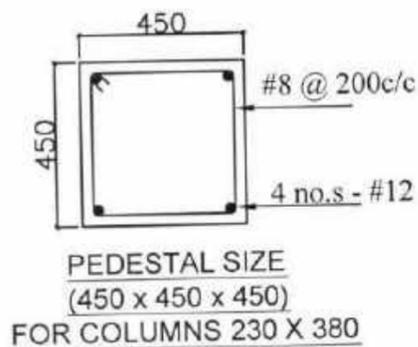

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500


//APPROVED//

Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

// TRUE COPY //

[Signature]
Dy. Executive Engineer, PR (Designs)

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	COLUMN & FOOTING SCHEDULE
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 3A
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

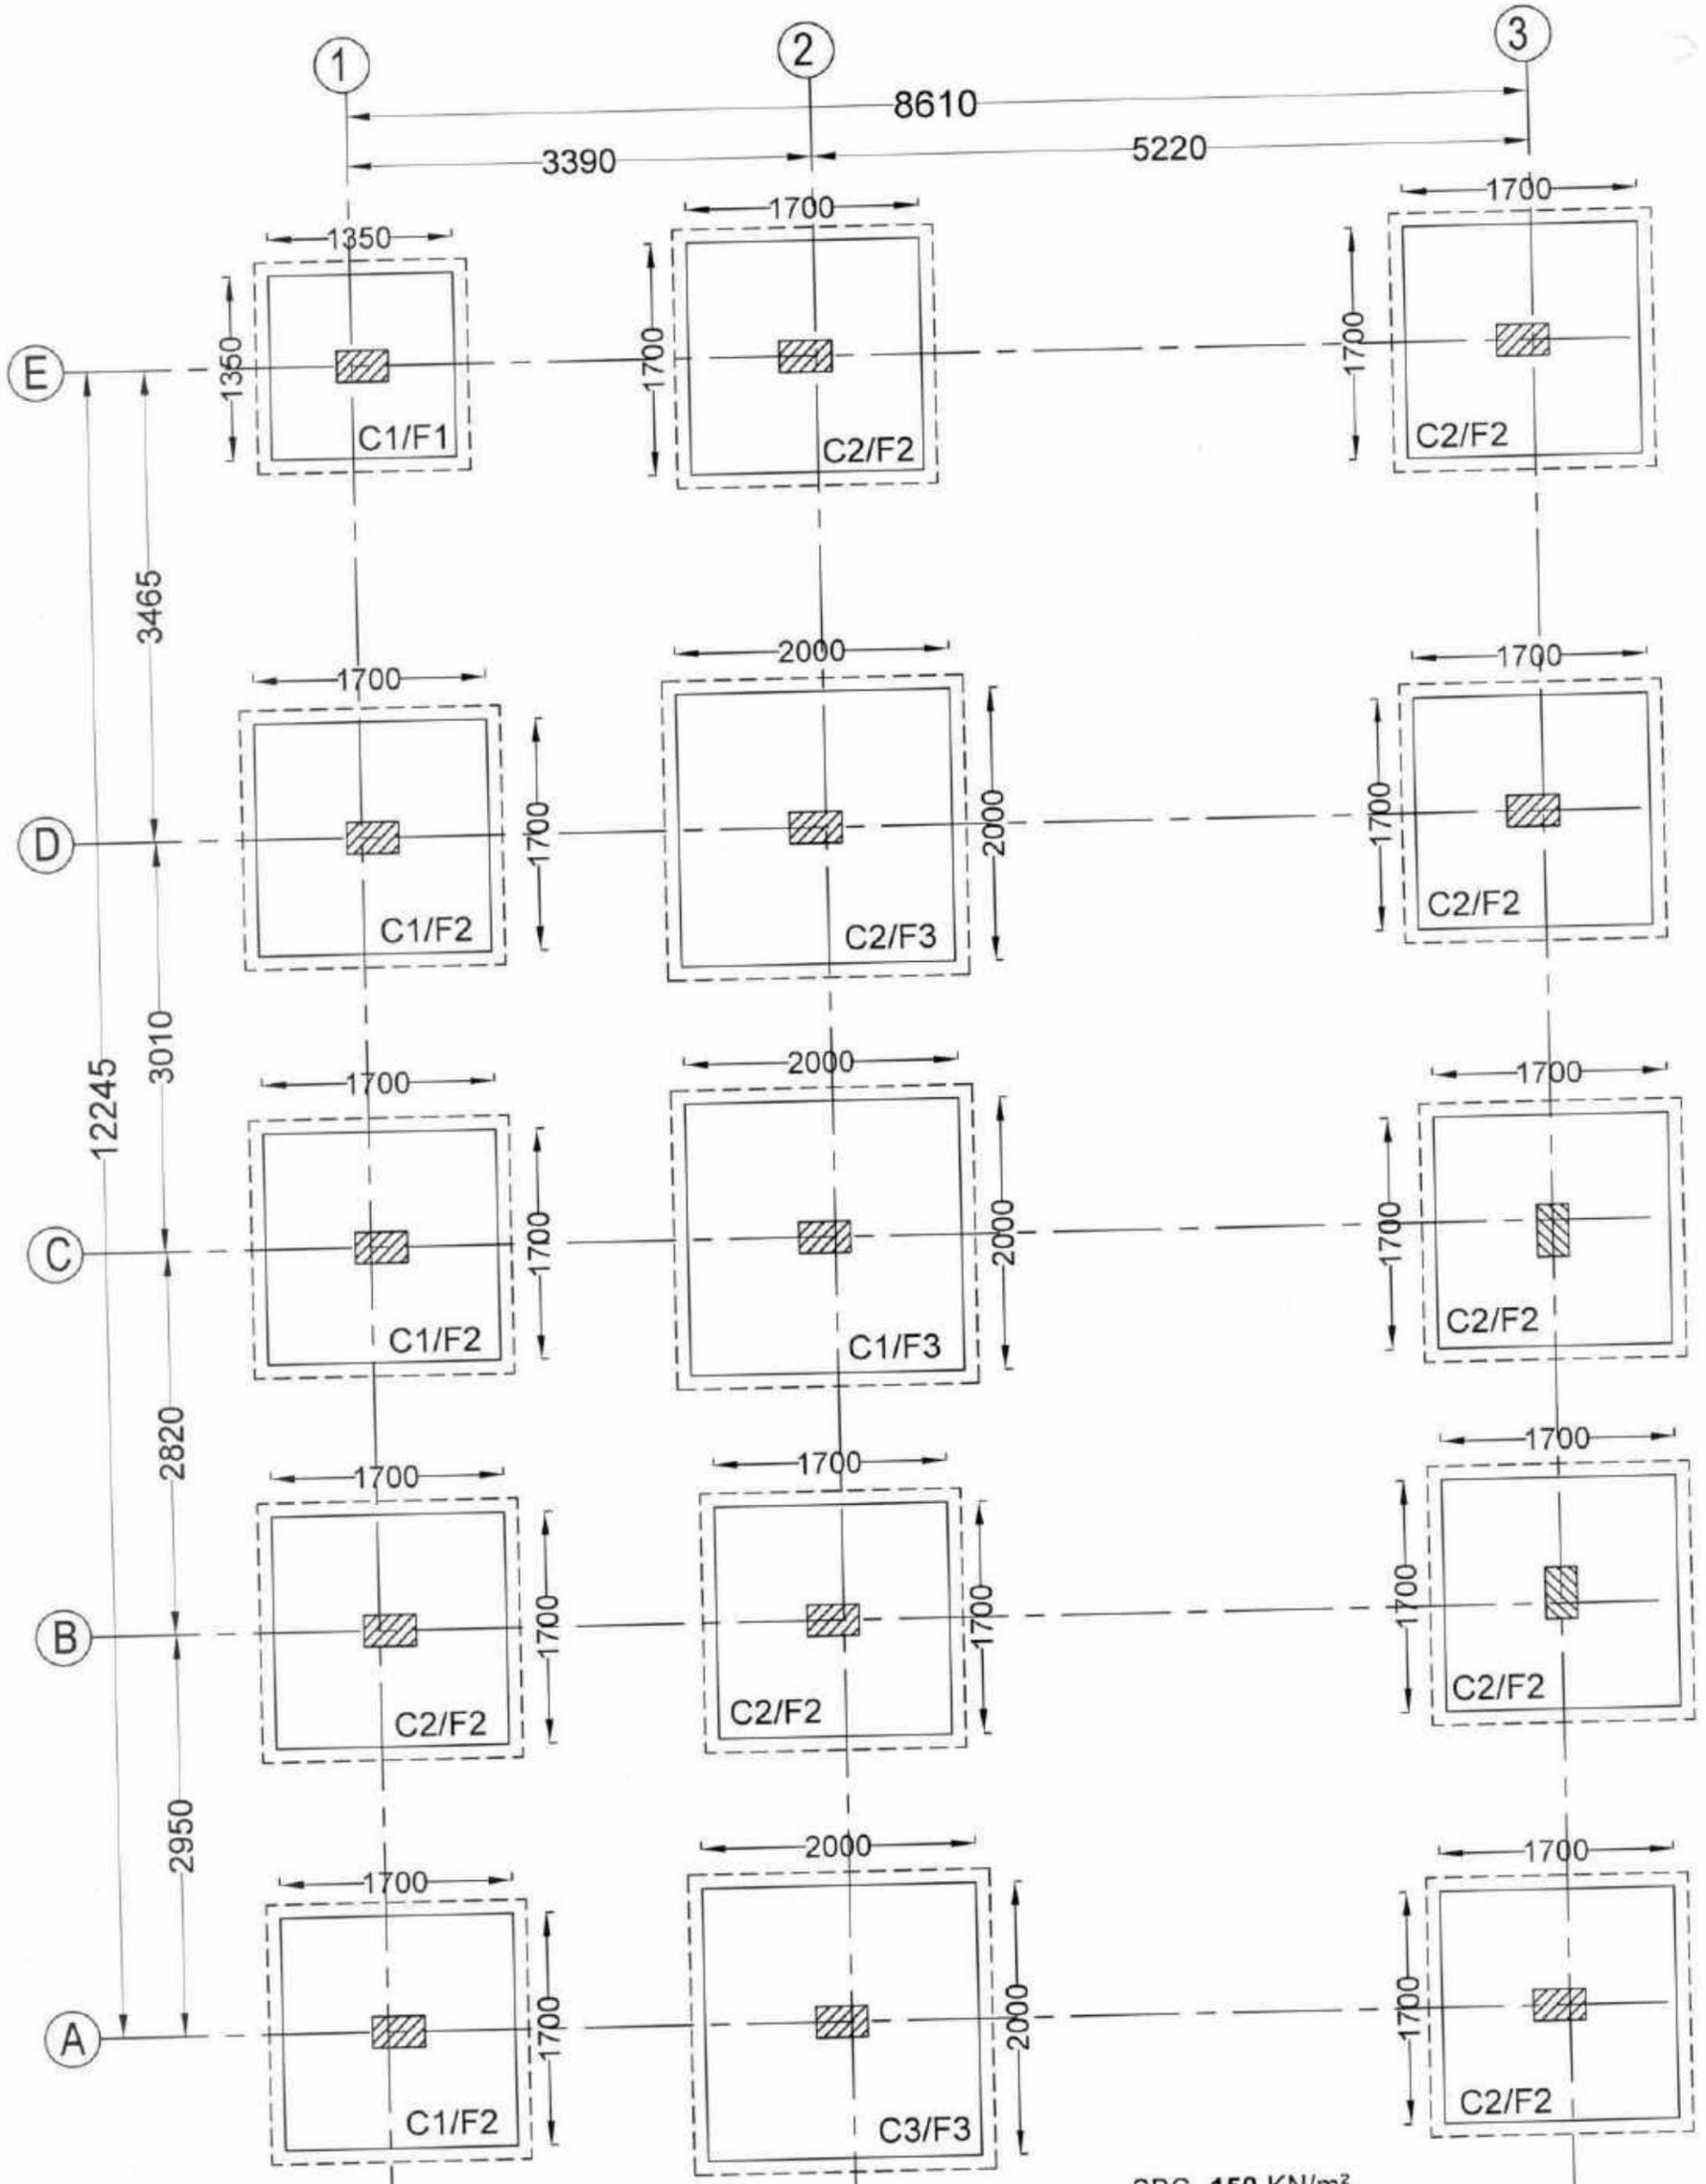

COLUMN & FOOTING LAYOUT

SBC -150 KN/m²

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500




//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer,PR II
Vijayawada.


// TRUE COPY //

Dy. Executive Engineer,PR (Designs)
4/11/19

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	COLUMN & FOOTING LAYOUT
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 2 B
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	


SCHEDULE OF COLUMNS

COLUMN GROUP	COLUMN SIZE	Reinforcement up to 1st Floor	SECTION
C1	230 x 380	●8-#12mm	 <p>1 TIE+2 links</p>
C2	230 x 380	●4-#16mm ○4-#12mm	 <p>1 TIE+2 links</p>
C3	230 x 380	●8-#16mm	 <p>1 TIE+2 links</p>

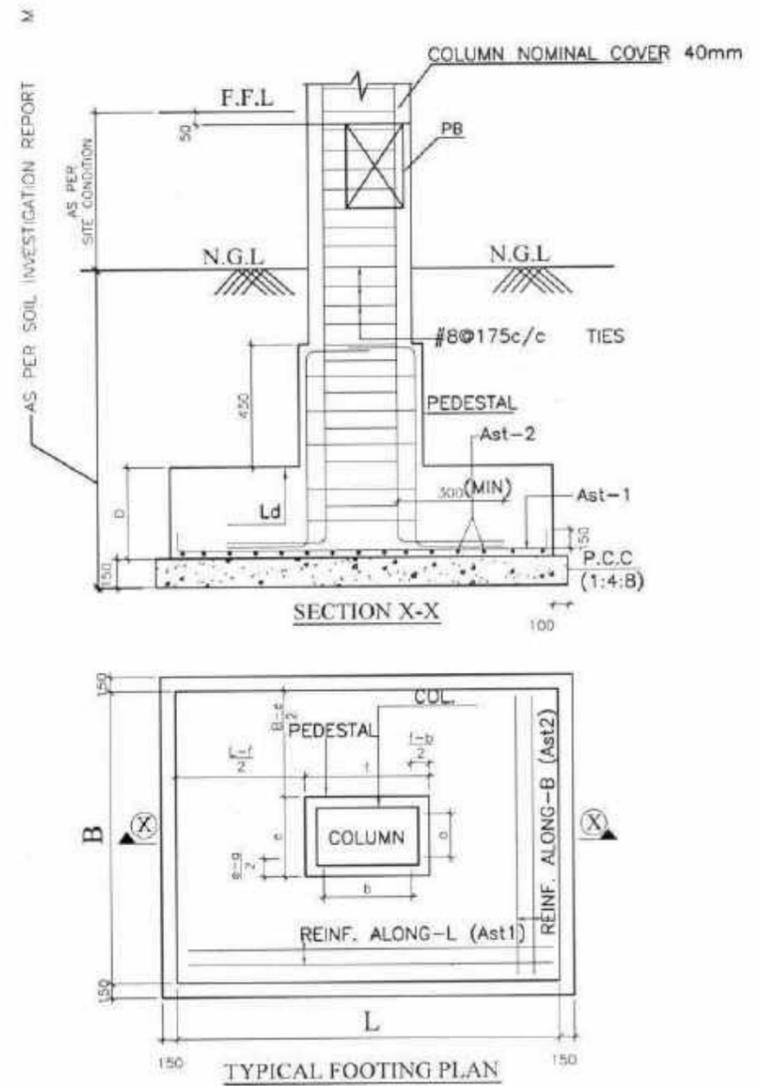

SCHEDULE OF FOOTINGS FOR SBC -150 KN/m²

Footing Group	Mix	Footing Size mm L x B	Depth mm	Bottom Reinforcement	
				REINFORCEMENT ALONG-L (Ast1)	REINFORCEMENT ALONG-B (Ast2)
F1	M30	1350 x 1350	300	Y 10- 8 Nos	Y 10- 8 Nos
F2	M30	1700 x 1700	350	Y 12- 10 Nos	Y 12- 10 Nos
F3	M30	2000 x 2000	400	Y 12- 13 Nos	Y 12- 13 Nos

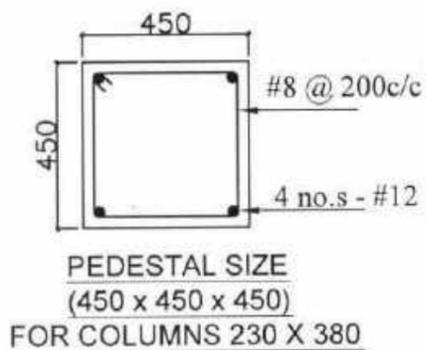

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500


//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

// TRUE COPY //

Dy. Executive Engineer, PR (Designs)

2/9/19

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	COLUMN & FOOTING SCHEDULE
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 3 B
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

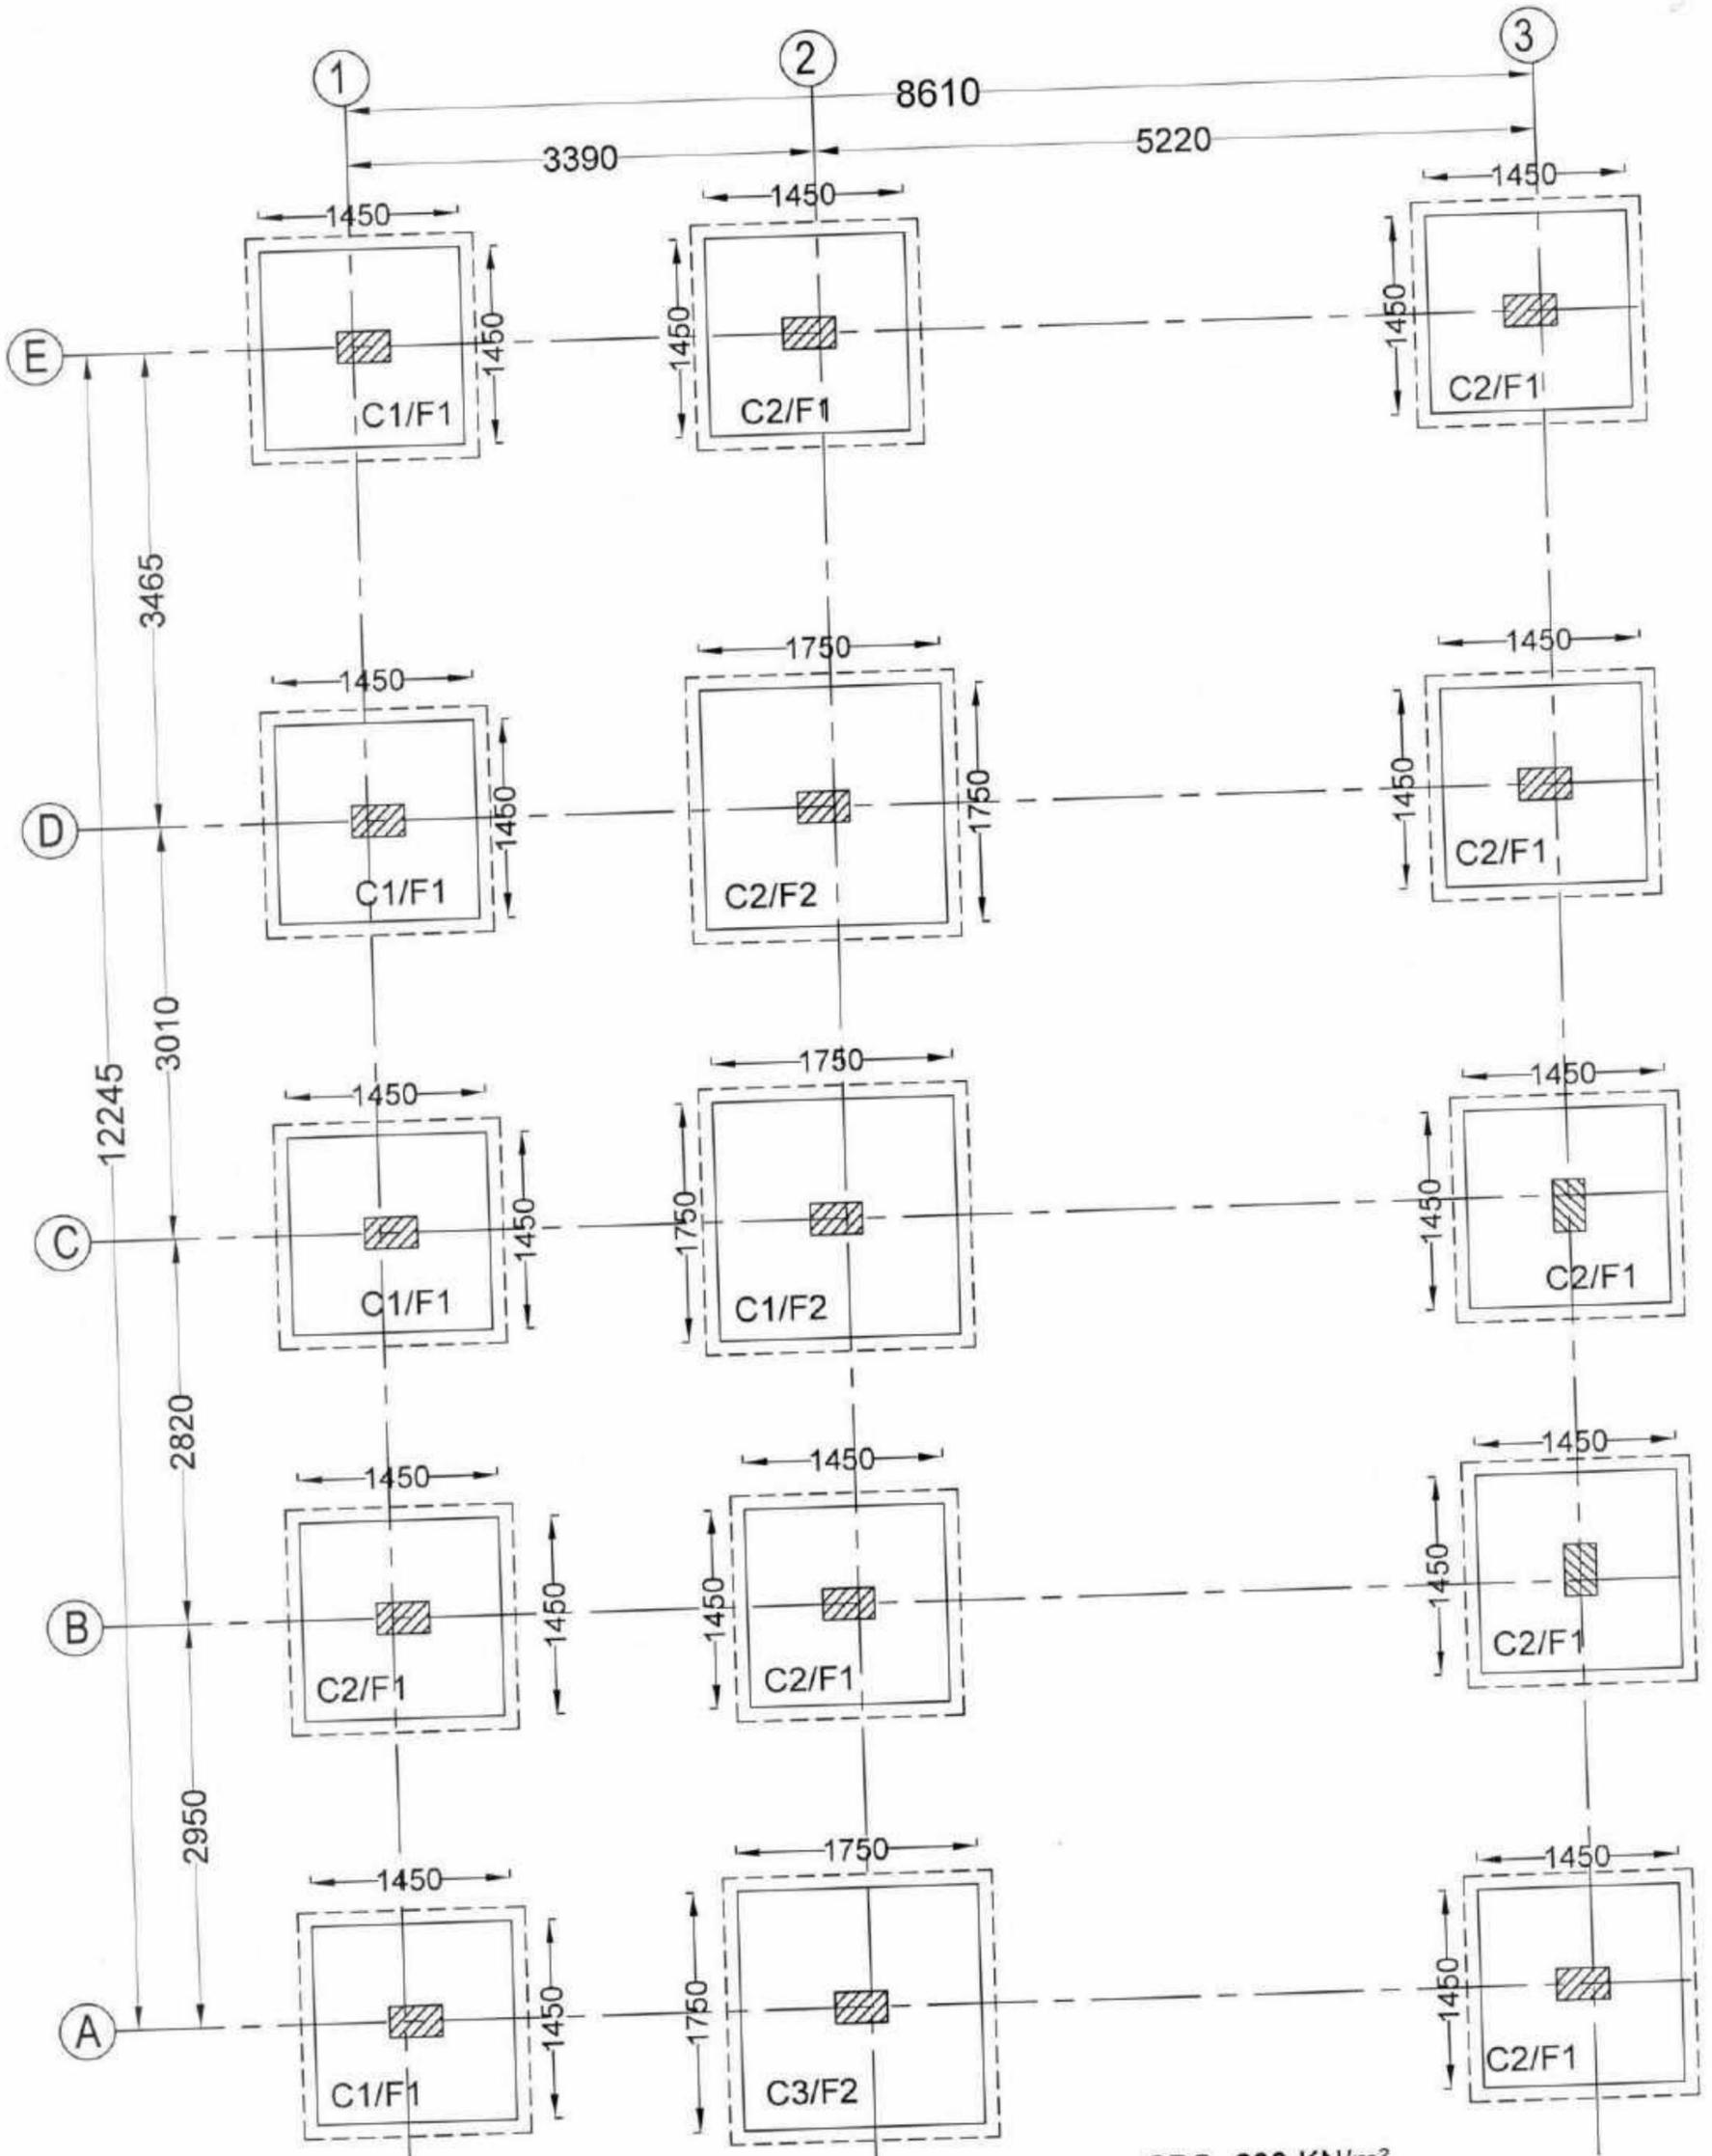

COLUMN & FOOTING LAYOUT

SBC - 200 KN/m²

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer,PR II
Vijayawada.

// TRUE COPY //

Dy. Executive Engineer,PR (Designs)

NAME OF WORK :
CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING



Drg. Title : COLUMN & FOOTING LAYOUT

Drg.No : PR / Grama Sachivalayam / Z II / M30 / SD / 2C

PANCHAYATI RAJ ENGINEERING DEPARTMENT
VIJAYAWADA.


SCHEDULE OF COLUMNS

COLUMN GROUP	COLUMN SIZE	Reinforcement up to 1st Floor	SECTION
C1	230 x 380	●8-#12mm	<p>1 TIE+2 links</p>
C2	230 x 380	●4-#16mm ○4-#12mm	<p>1 TIE+2 links</p>
C3	230 x 380	●8-#16mm	<p>1 TIE+2 links</p>

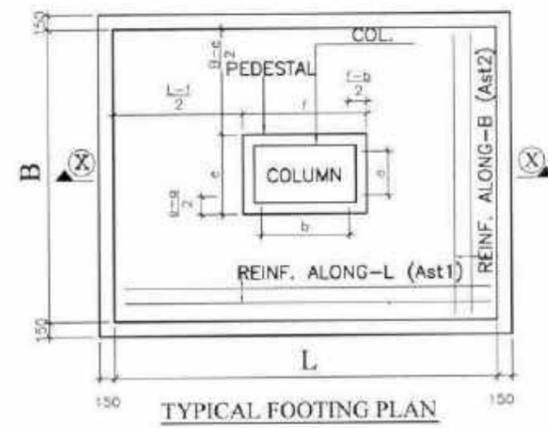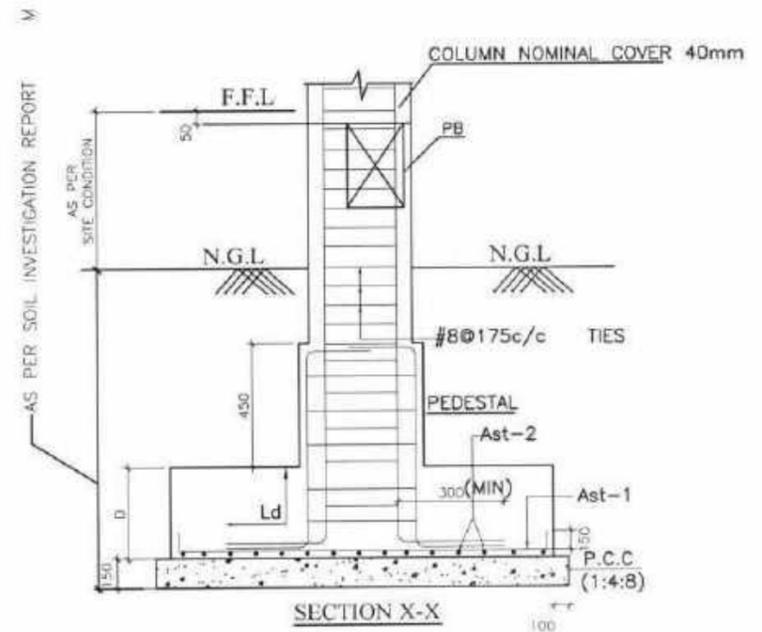

SCHEDULE OF FOOTINGS FOR SBC -200 KN/m²

Footing Group	Mix	Footing Size mm L x B	Depth mm	Bottom Reinforcement	
				REINFORCEMENT ALONG-L (Ast1)	REINFORCEMENT ALONG-B (Ast2)
F1	M30	1450 x 1450	325	Y 10- 11 Nos	Y 10- 11 Nos
F2	M30	1750 x 1750	400	Y 12- 11 Nos	Y 12- 11 Nos

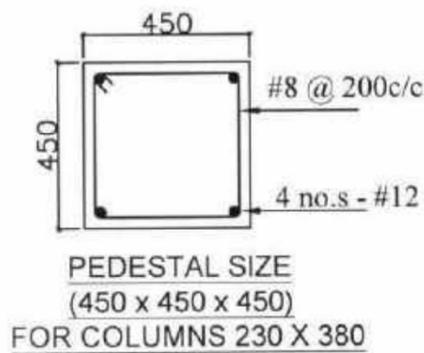

**//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer,PR II
Vijayawada.**


// TRUE COPY //

[Signature]
Dy. Executive Engineer,PR (Designs)

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	COLUMN & FOOTING SCHEDULE
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 3C
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

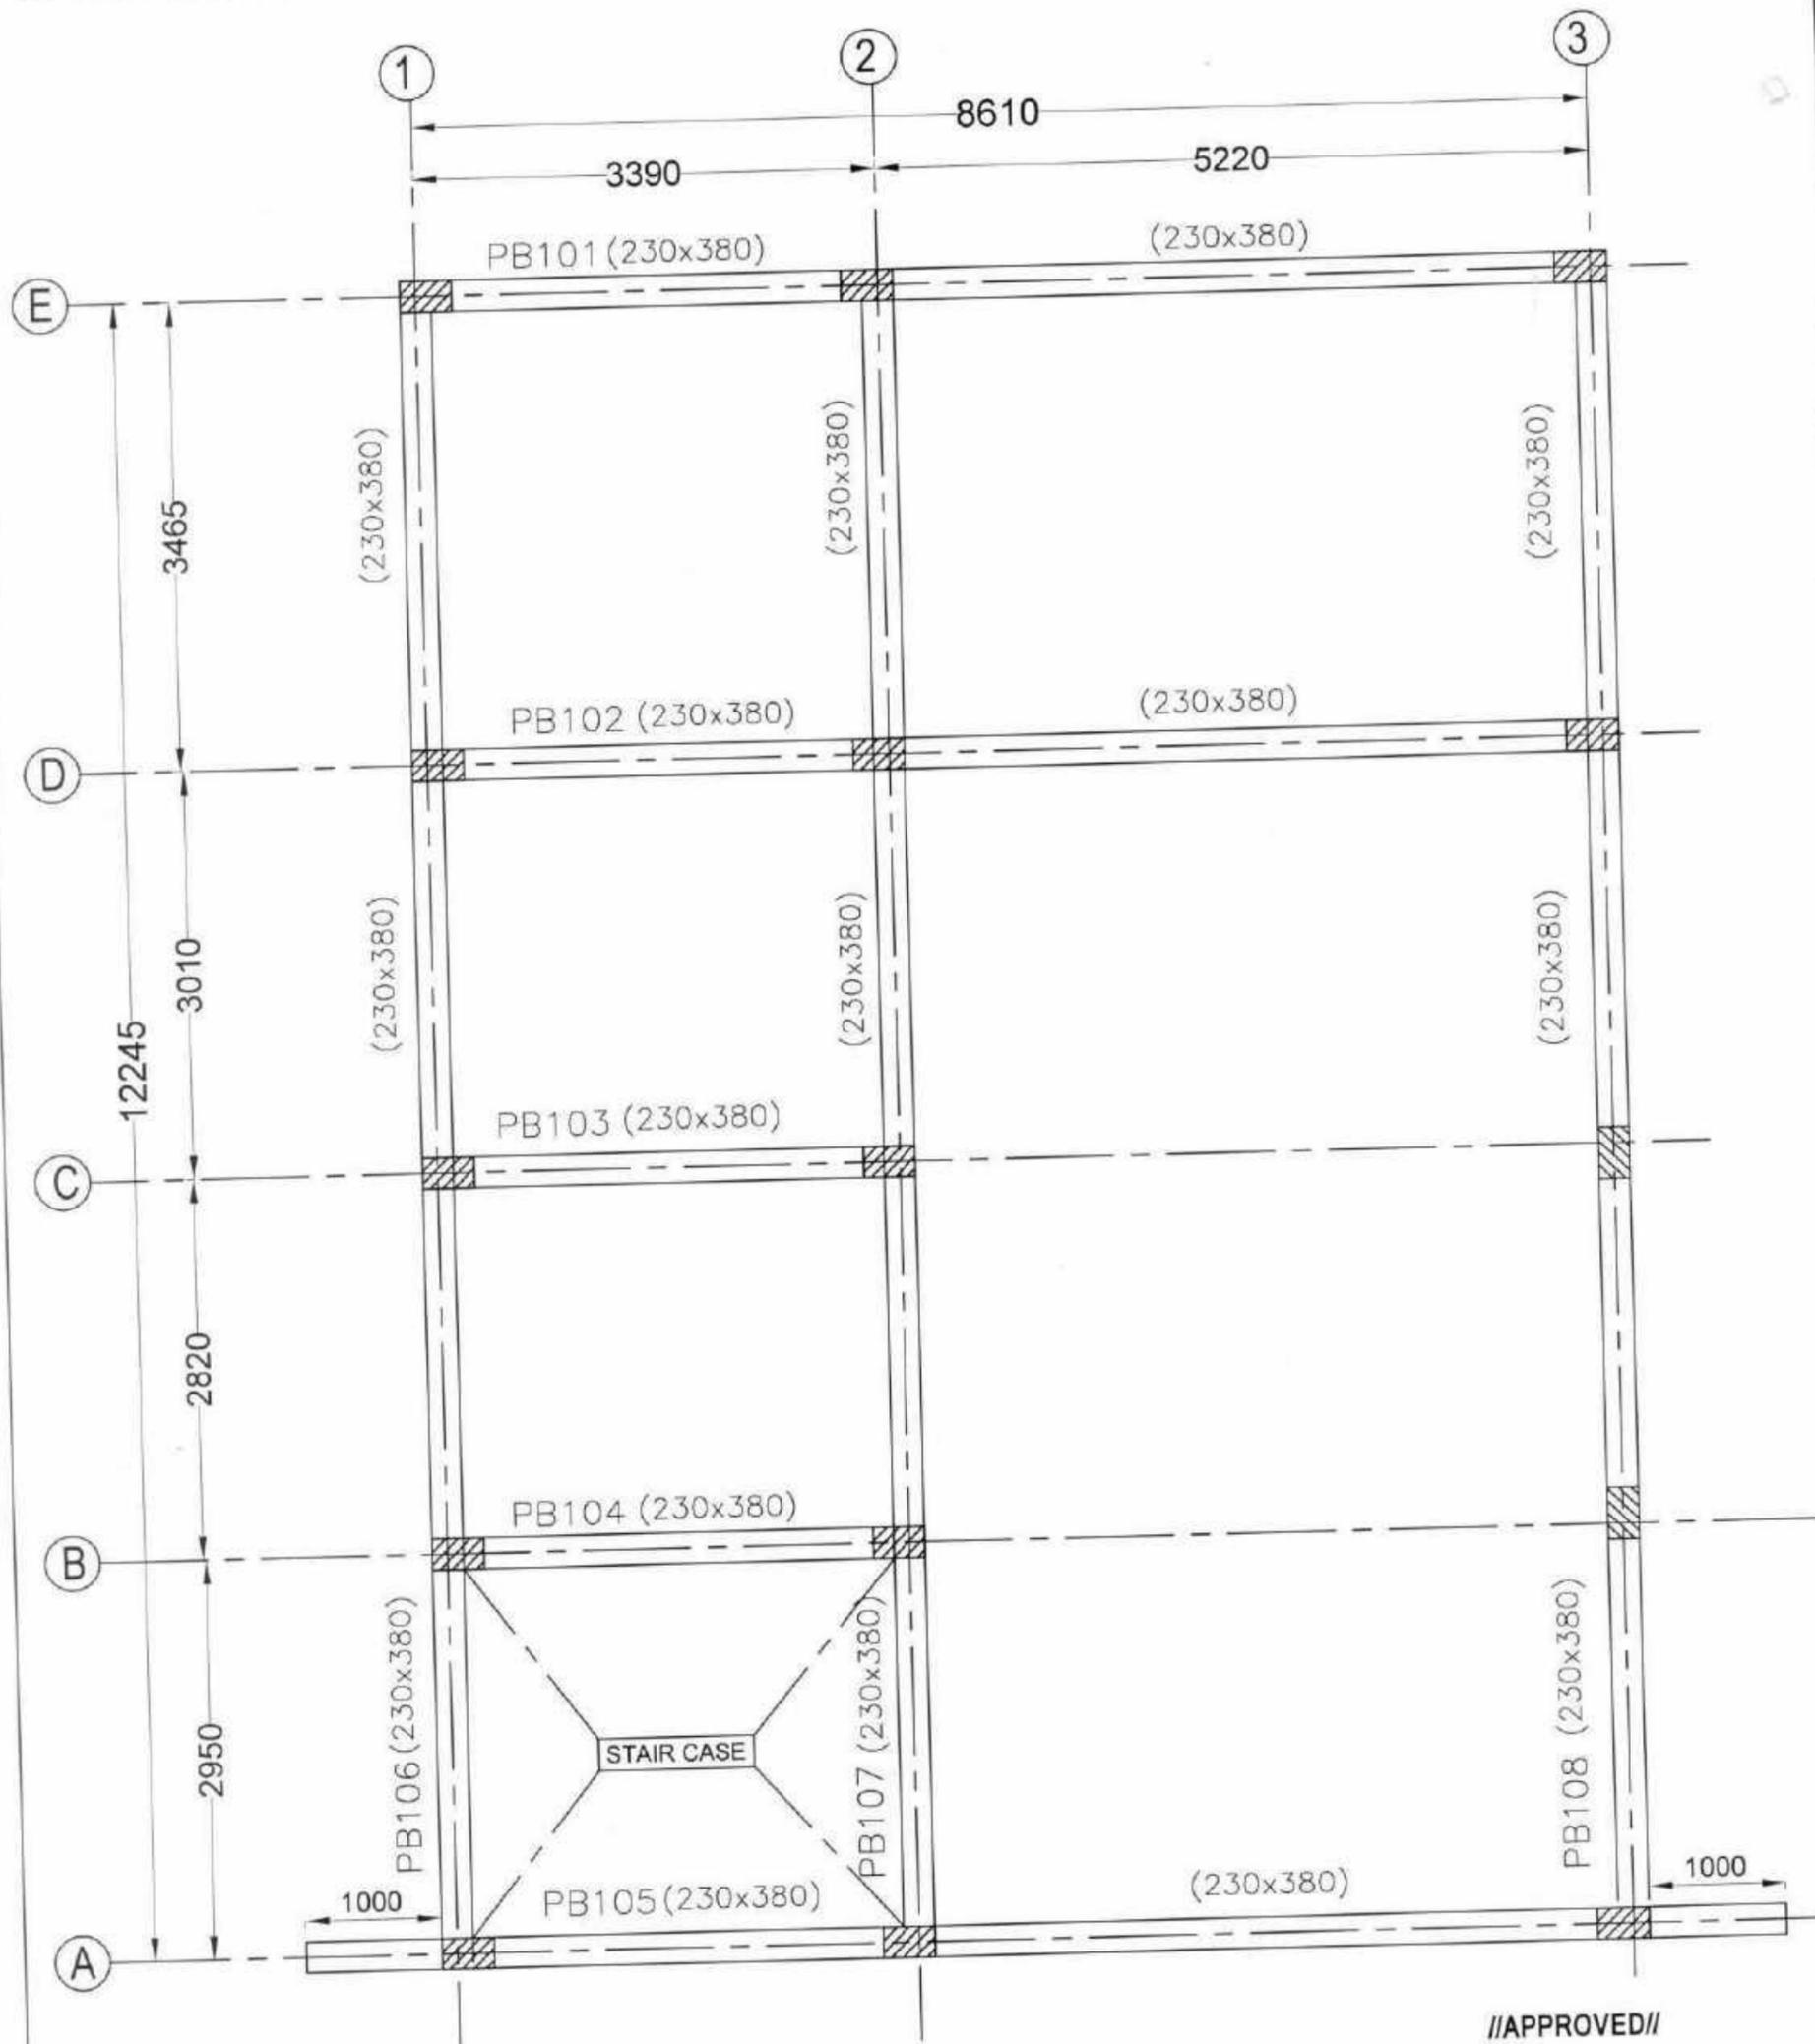

PLINTH BEAM LAYOUT


//APPROVED//

Sd/- 04 / 11 / 19

Chief Engineer, PR II
Vijayawada.


// TRUE COPY //

Dy. Executive Engineer, PR (Designs)

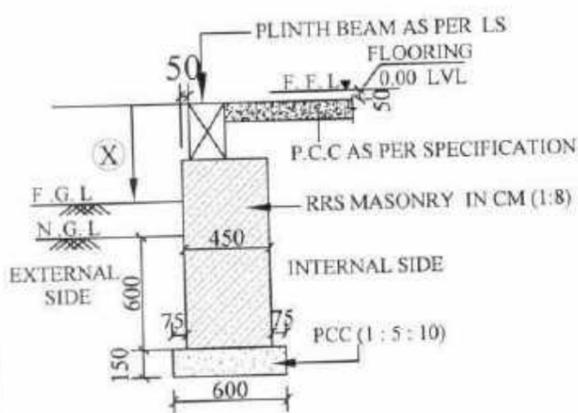

TYPICAL EXTERNAL PLINTH BEAM (EPB) DETAILS

(X) VARIABLE AS PER SITE CONDITIONS TO A MAXIMUM OF 600 mm

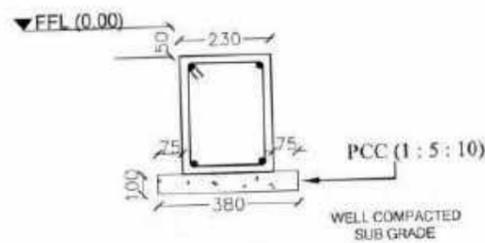


TYPICAL INTERNAL PLINTH BEAM DETAILS


Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500


NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	PLINTH BEAM LAYOUT
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 04
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

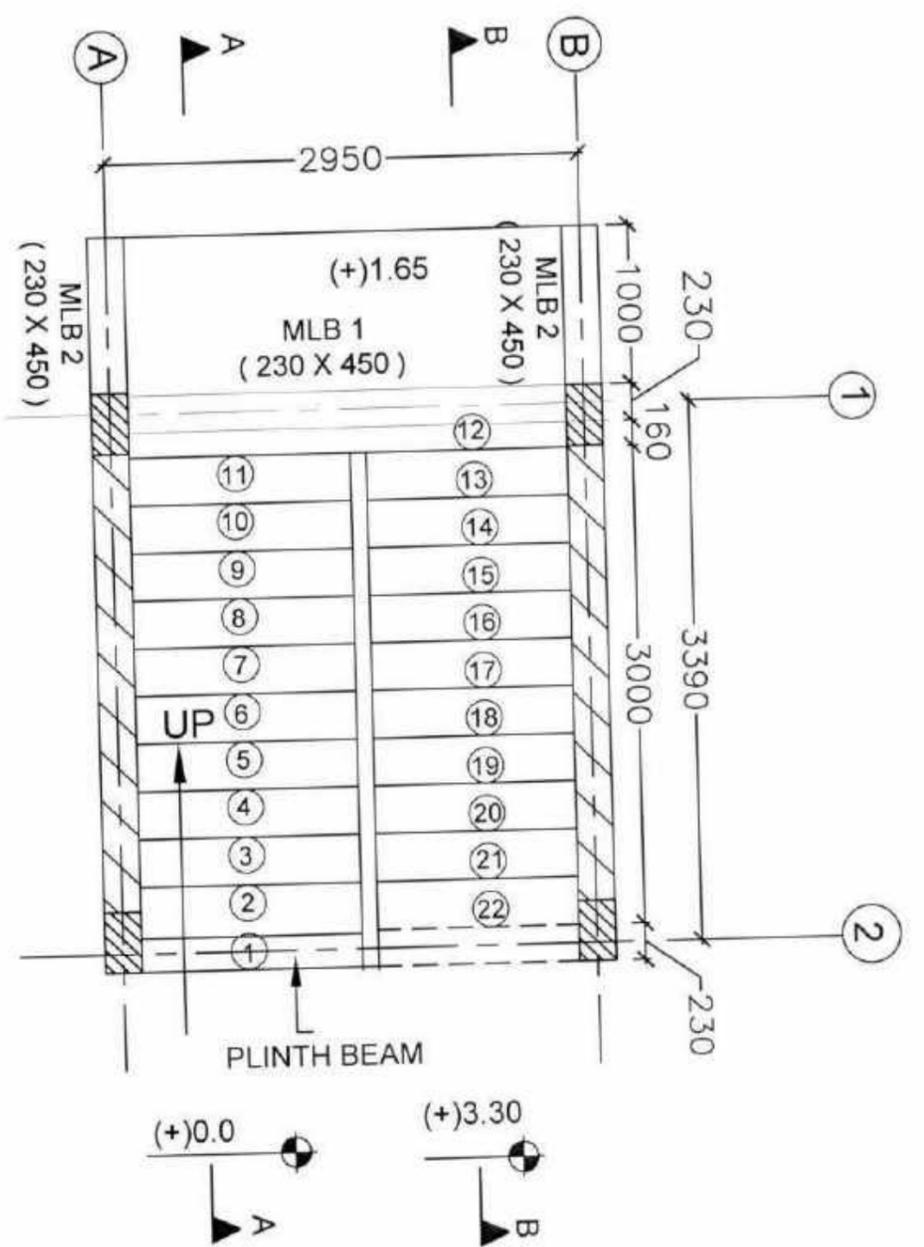

PLAN

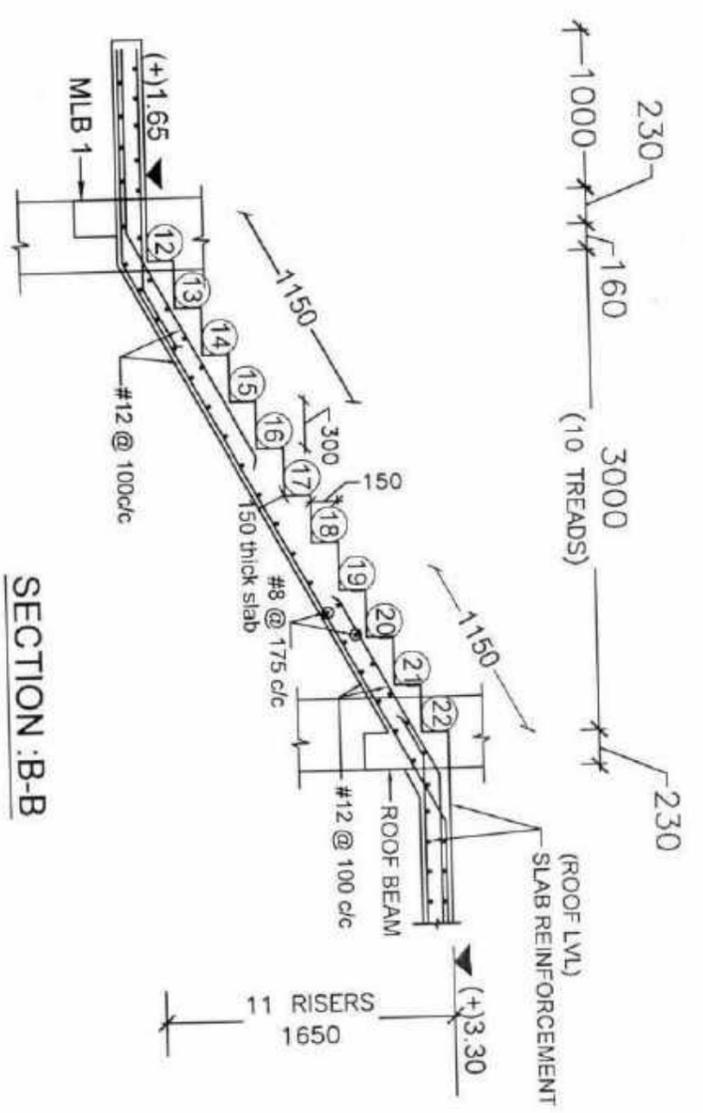


SECTION : B-B

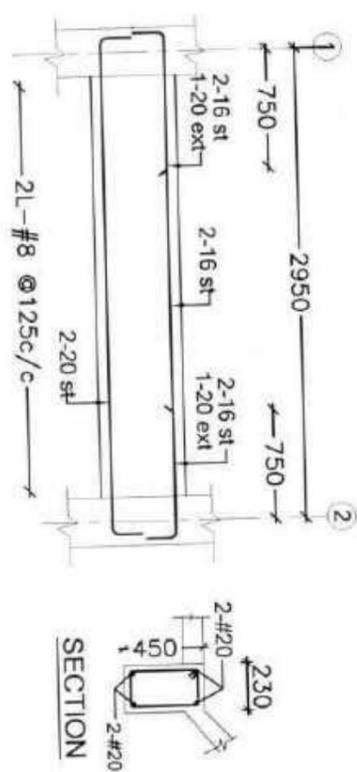

MLB 1 (230 X 450)




MLB 2 (230 X 450)

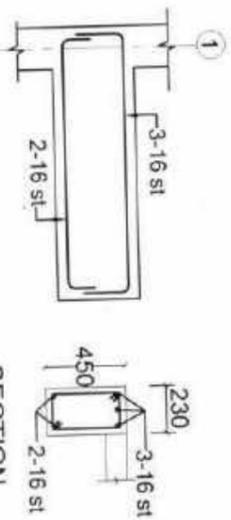

2L-#8 @100c/c

MLB 2 (230 X 450)

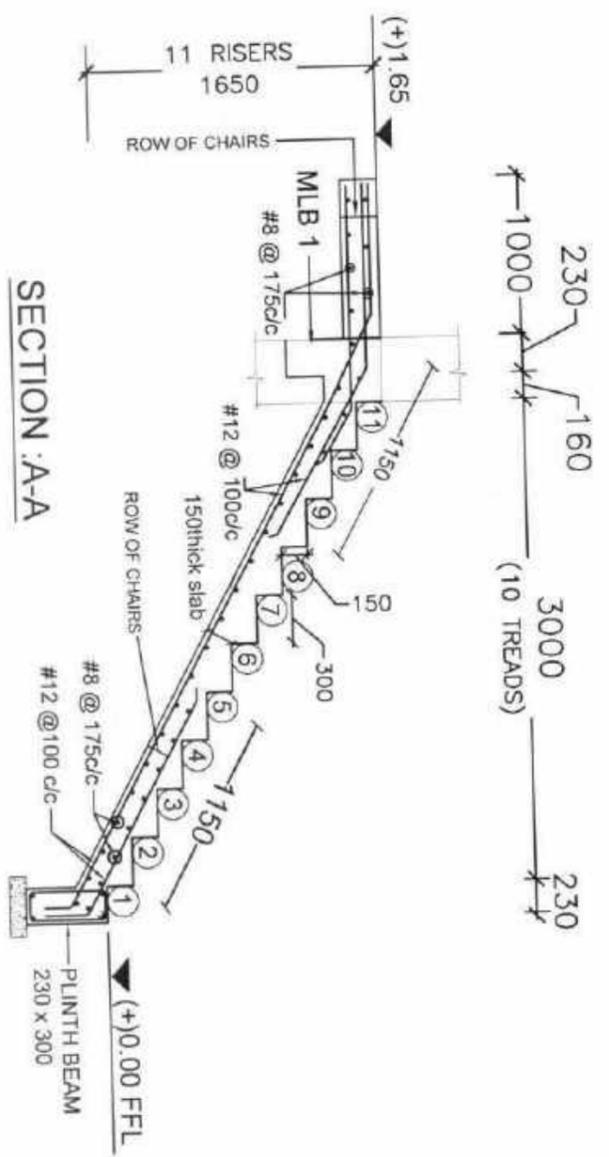

SECTION : A-A

WAIST SLAB THICKNESS - 150
RISE - 150
TREAD - 300
MAIN STEEL - # 12 @ 100 c/c
DIST. STEEL - # 8 @ 175 c/c

//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

// TRUE COPY //

Dy. Executive Engineer, PR (Designs)

Radial Distance Upto 50 Km From Coast line

Seismic Zone II, Grade of Concrete : M30, Steel Grade : Fe500


NAME OF WORK :

CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING

Dwg. Title : STAIR CASE DETAILS

Dwg.No : PR / Grama Sachivalayam / Z II / M30 / SD / 06

PANCHAYATI RAJ ENGINEERING DEPARTMENT
VIJAYAWADA

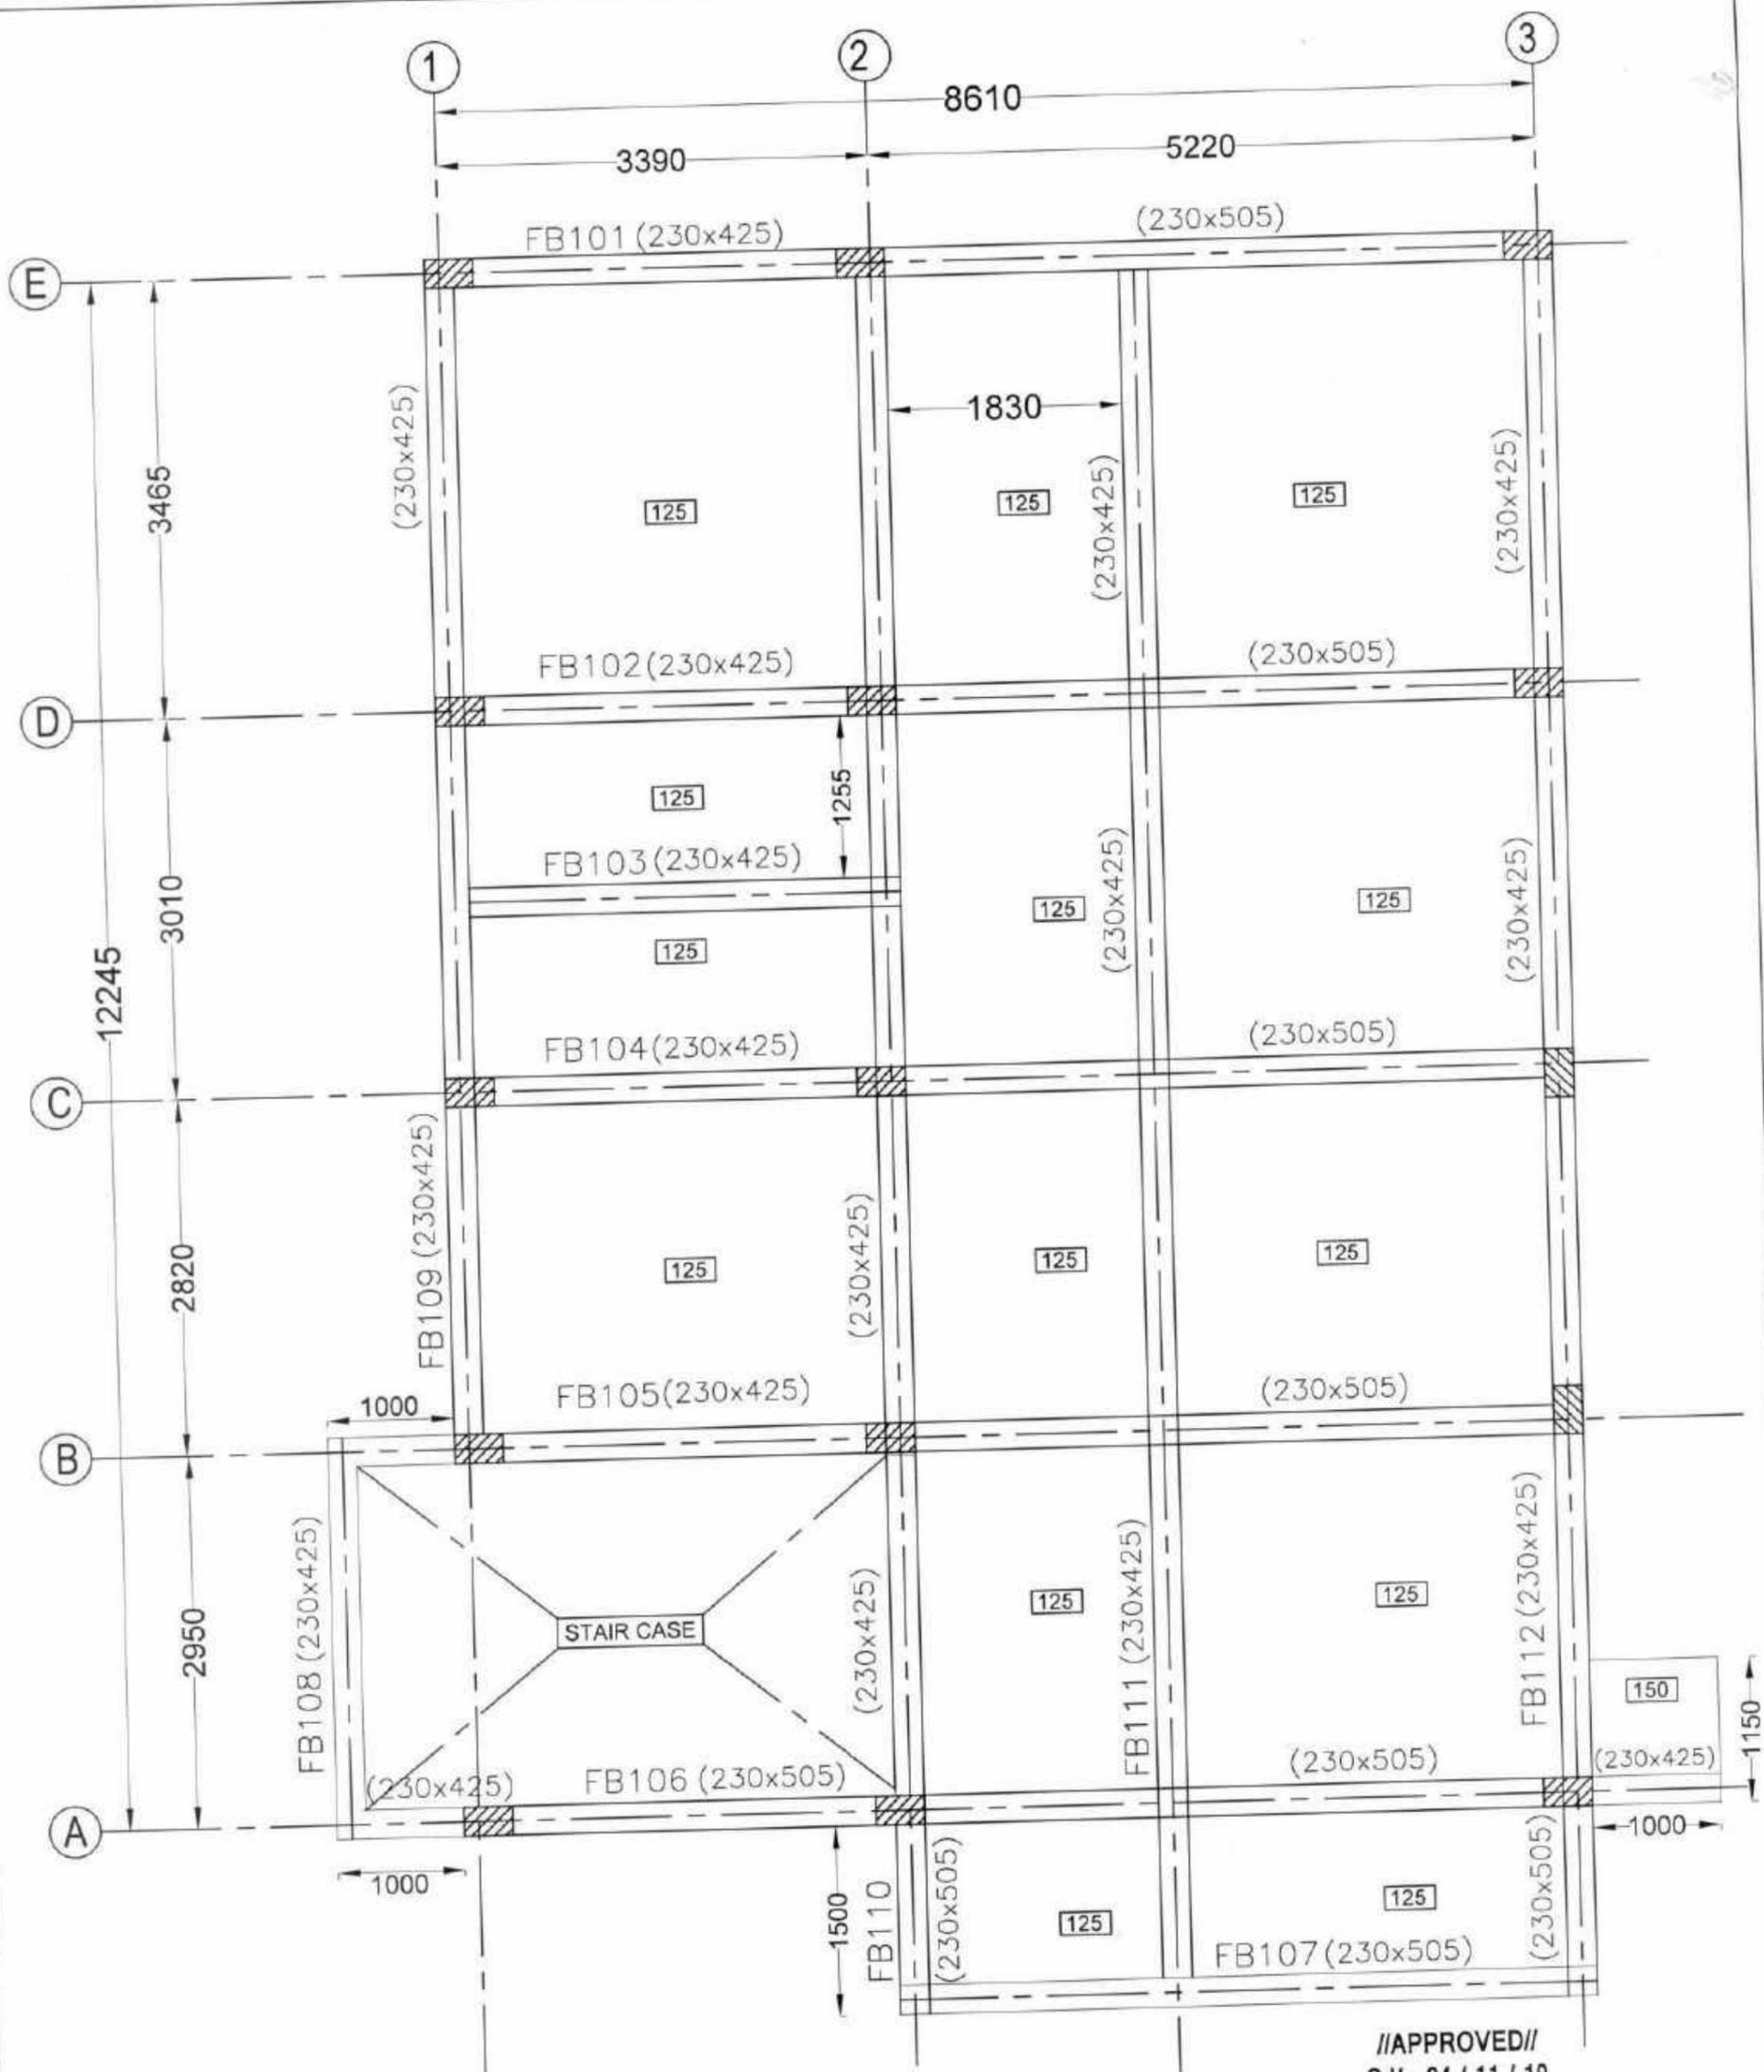

GROUND FLOOR ROOF BEAM LAYOUT

//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

// TRUE COPY //


NOTE: All Slabs are 125 mm thickness unless otherwise mentioned

Dy. Executive Engineer, PR (Designs)

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	GROUND FLOOR ROOF BEAM LAYOUT
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 07
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

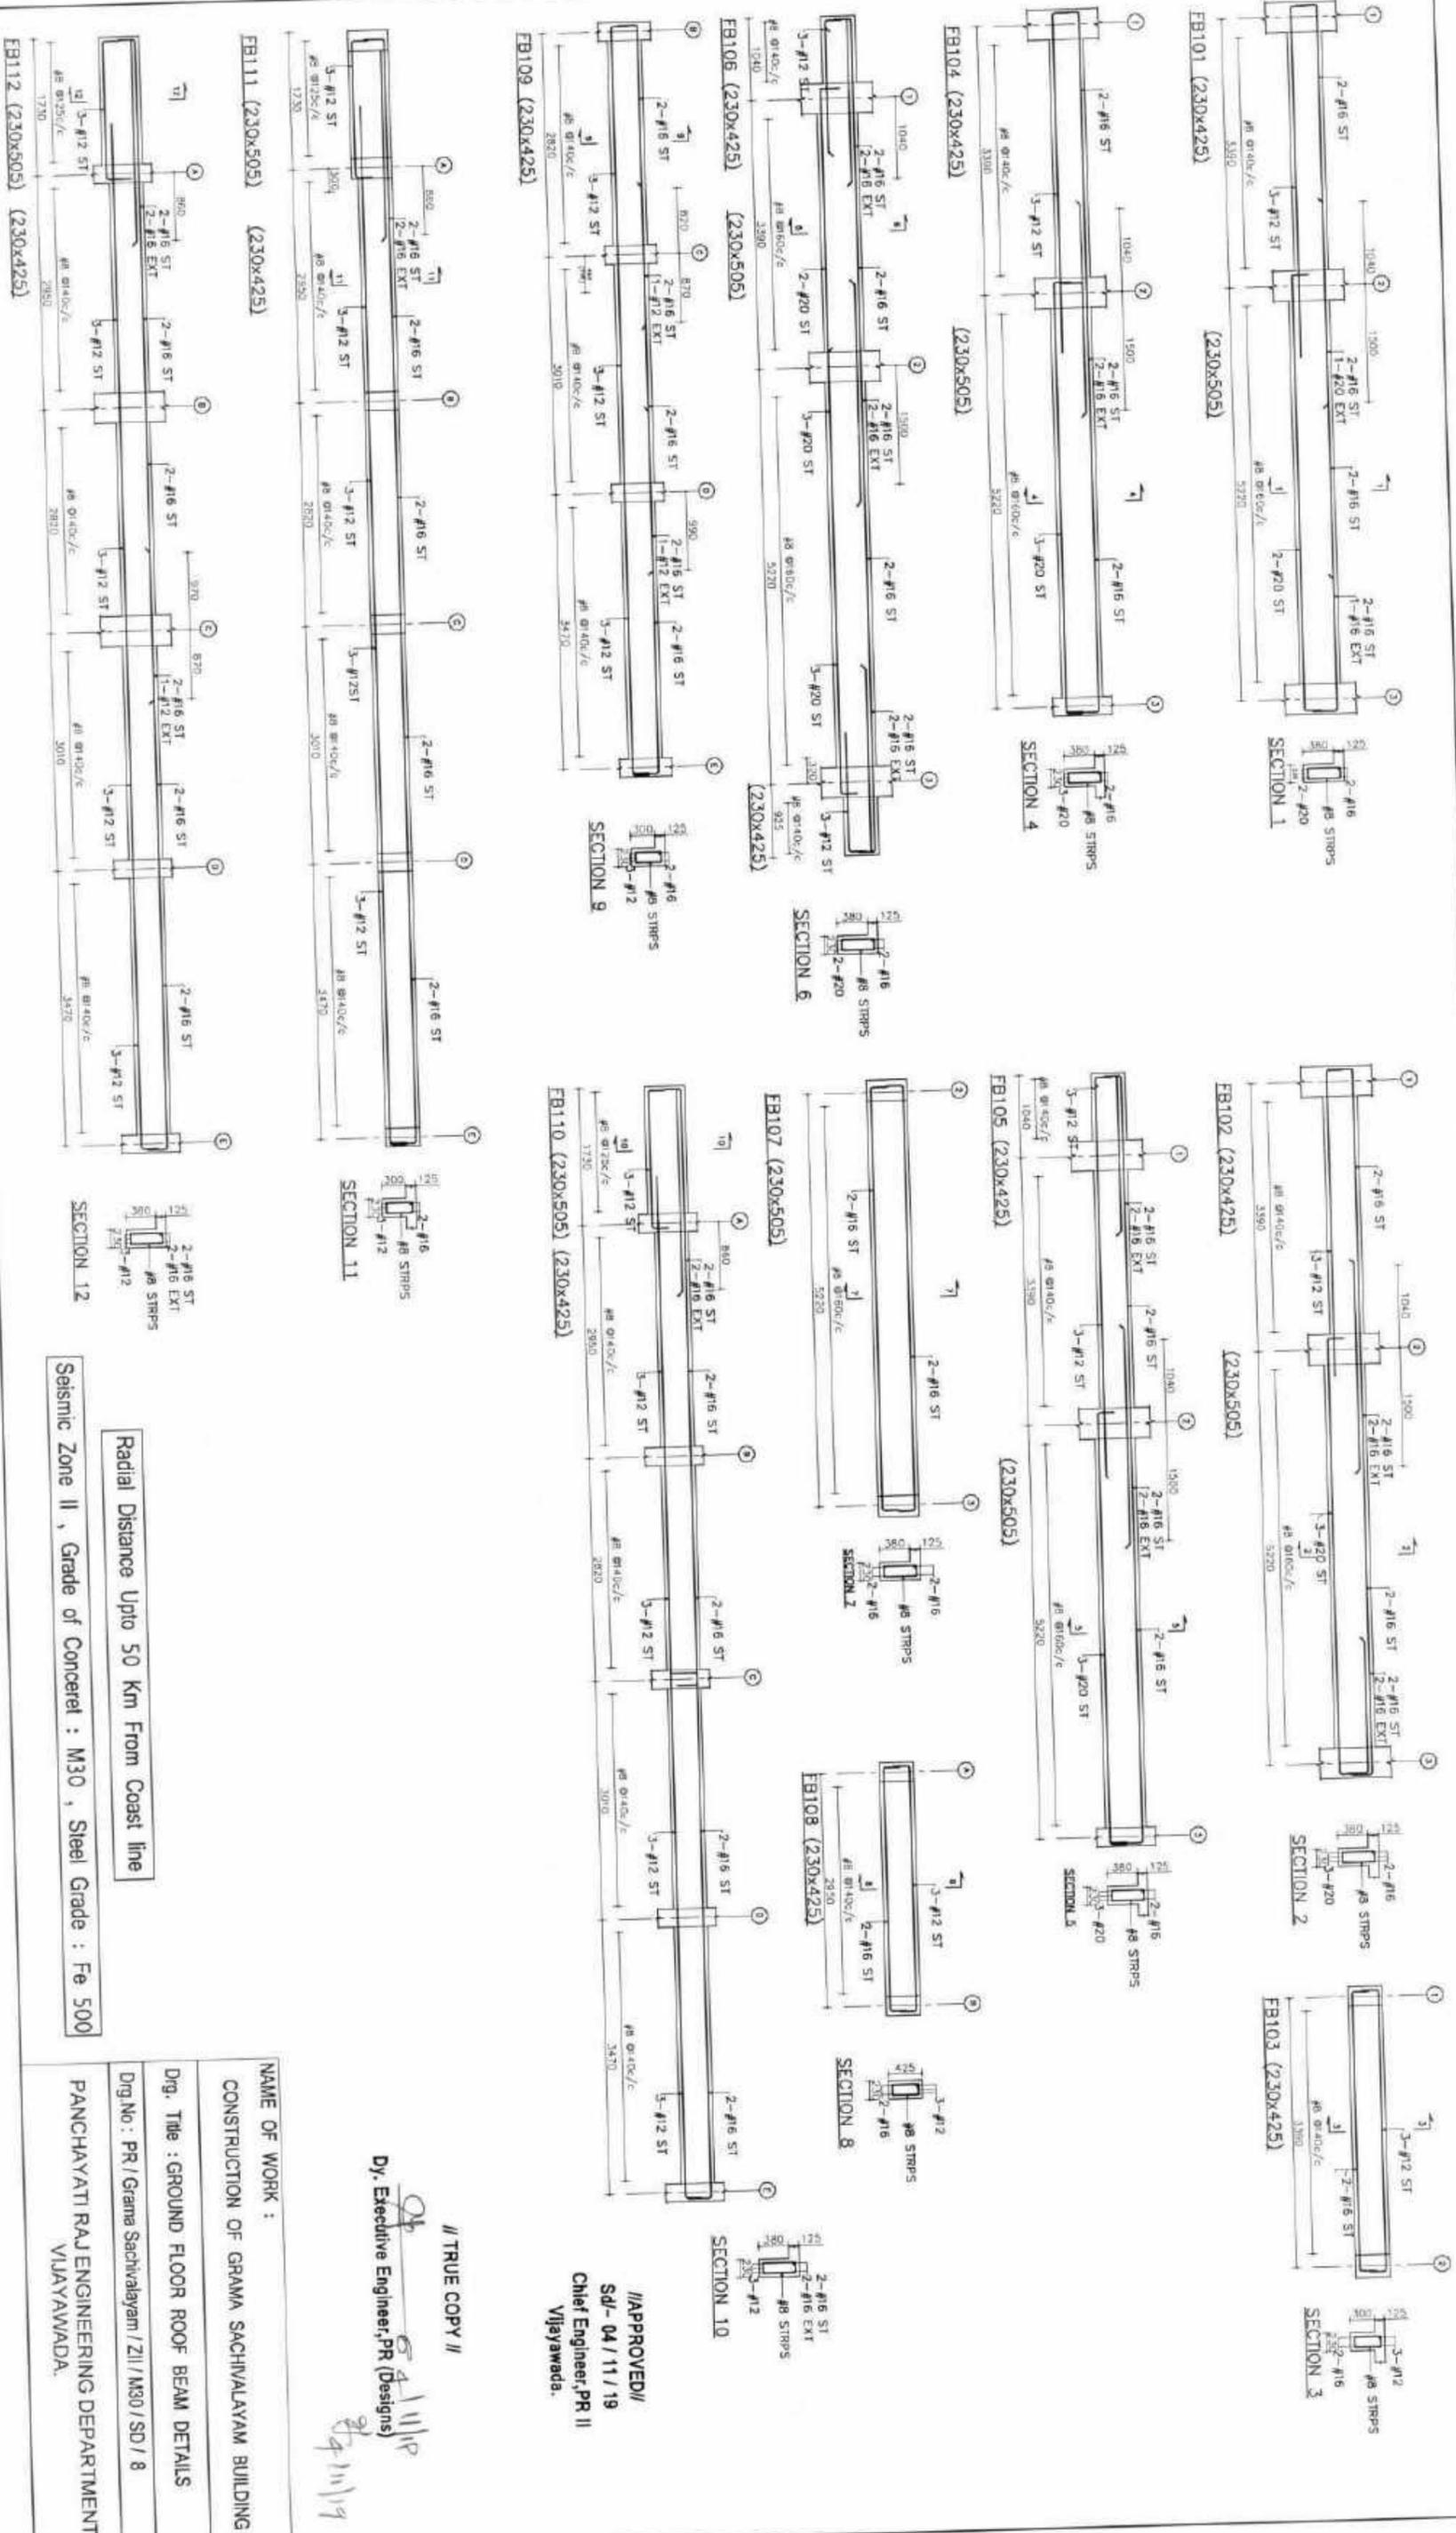


Radial Distance Up to 50 Km From Coast line
 Seismic Zone II, Grade of Concrete : M30, Steel Grade : Fe 500


NAME OF WORK :
 CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
 Dwg. Title : GROUND FLOOR ROOF BEAM DETAILS
 Dwg No : PR / Grama Sachivalayam / ZII / M30 / SD / 8
 PANCHAYATI RAJ ENGINEERING DEPARTMENT
 VIJAYAWADA.

// TRUE COPY //
 Dy. Executive Engineer, PR (Designs)
 24/11/19

// APPROVED //
 SD - 04 / 11 / 19
 Chief Engineer, PR II
 Vijayawada.

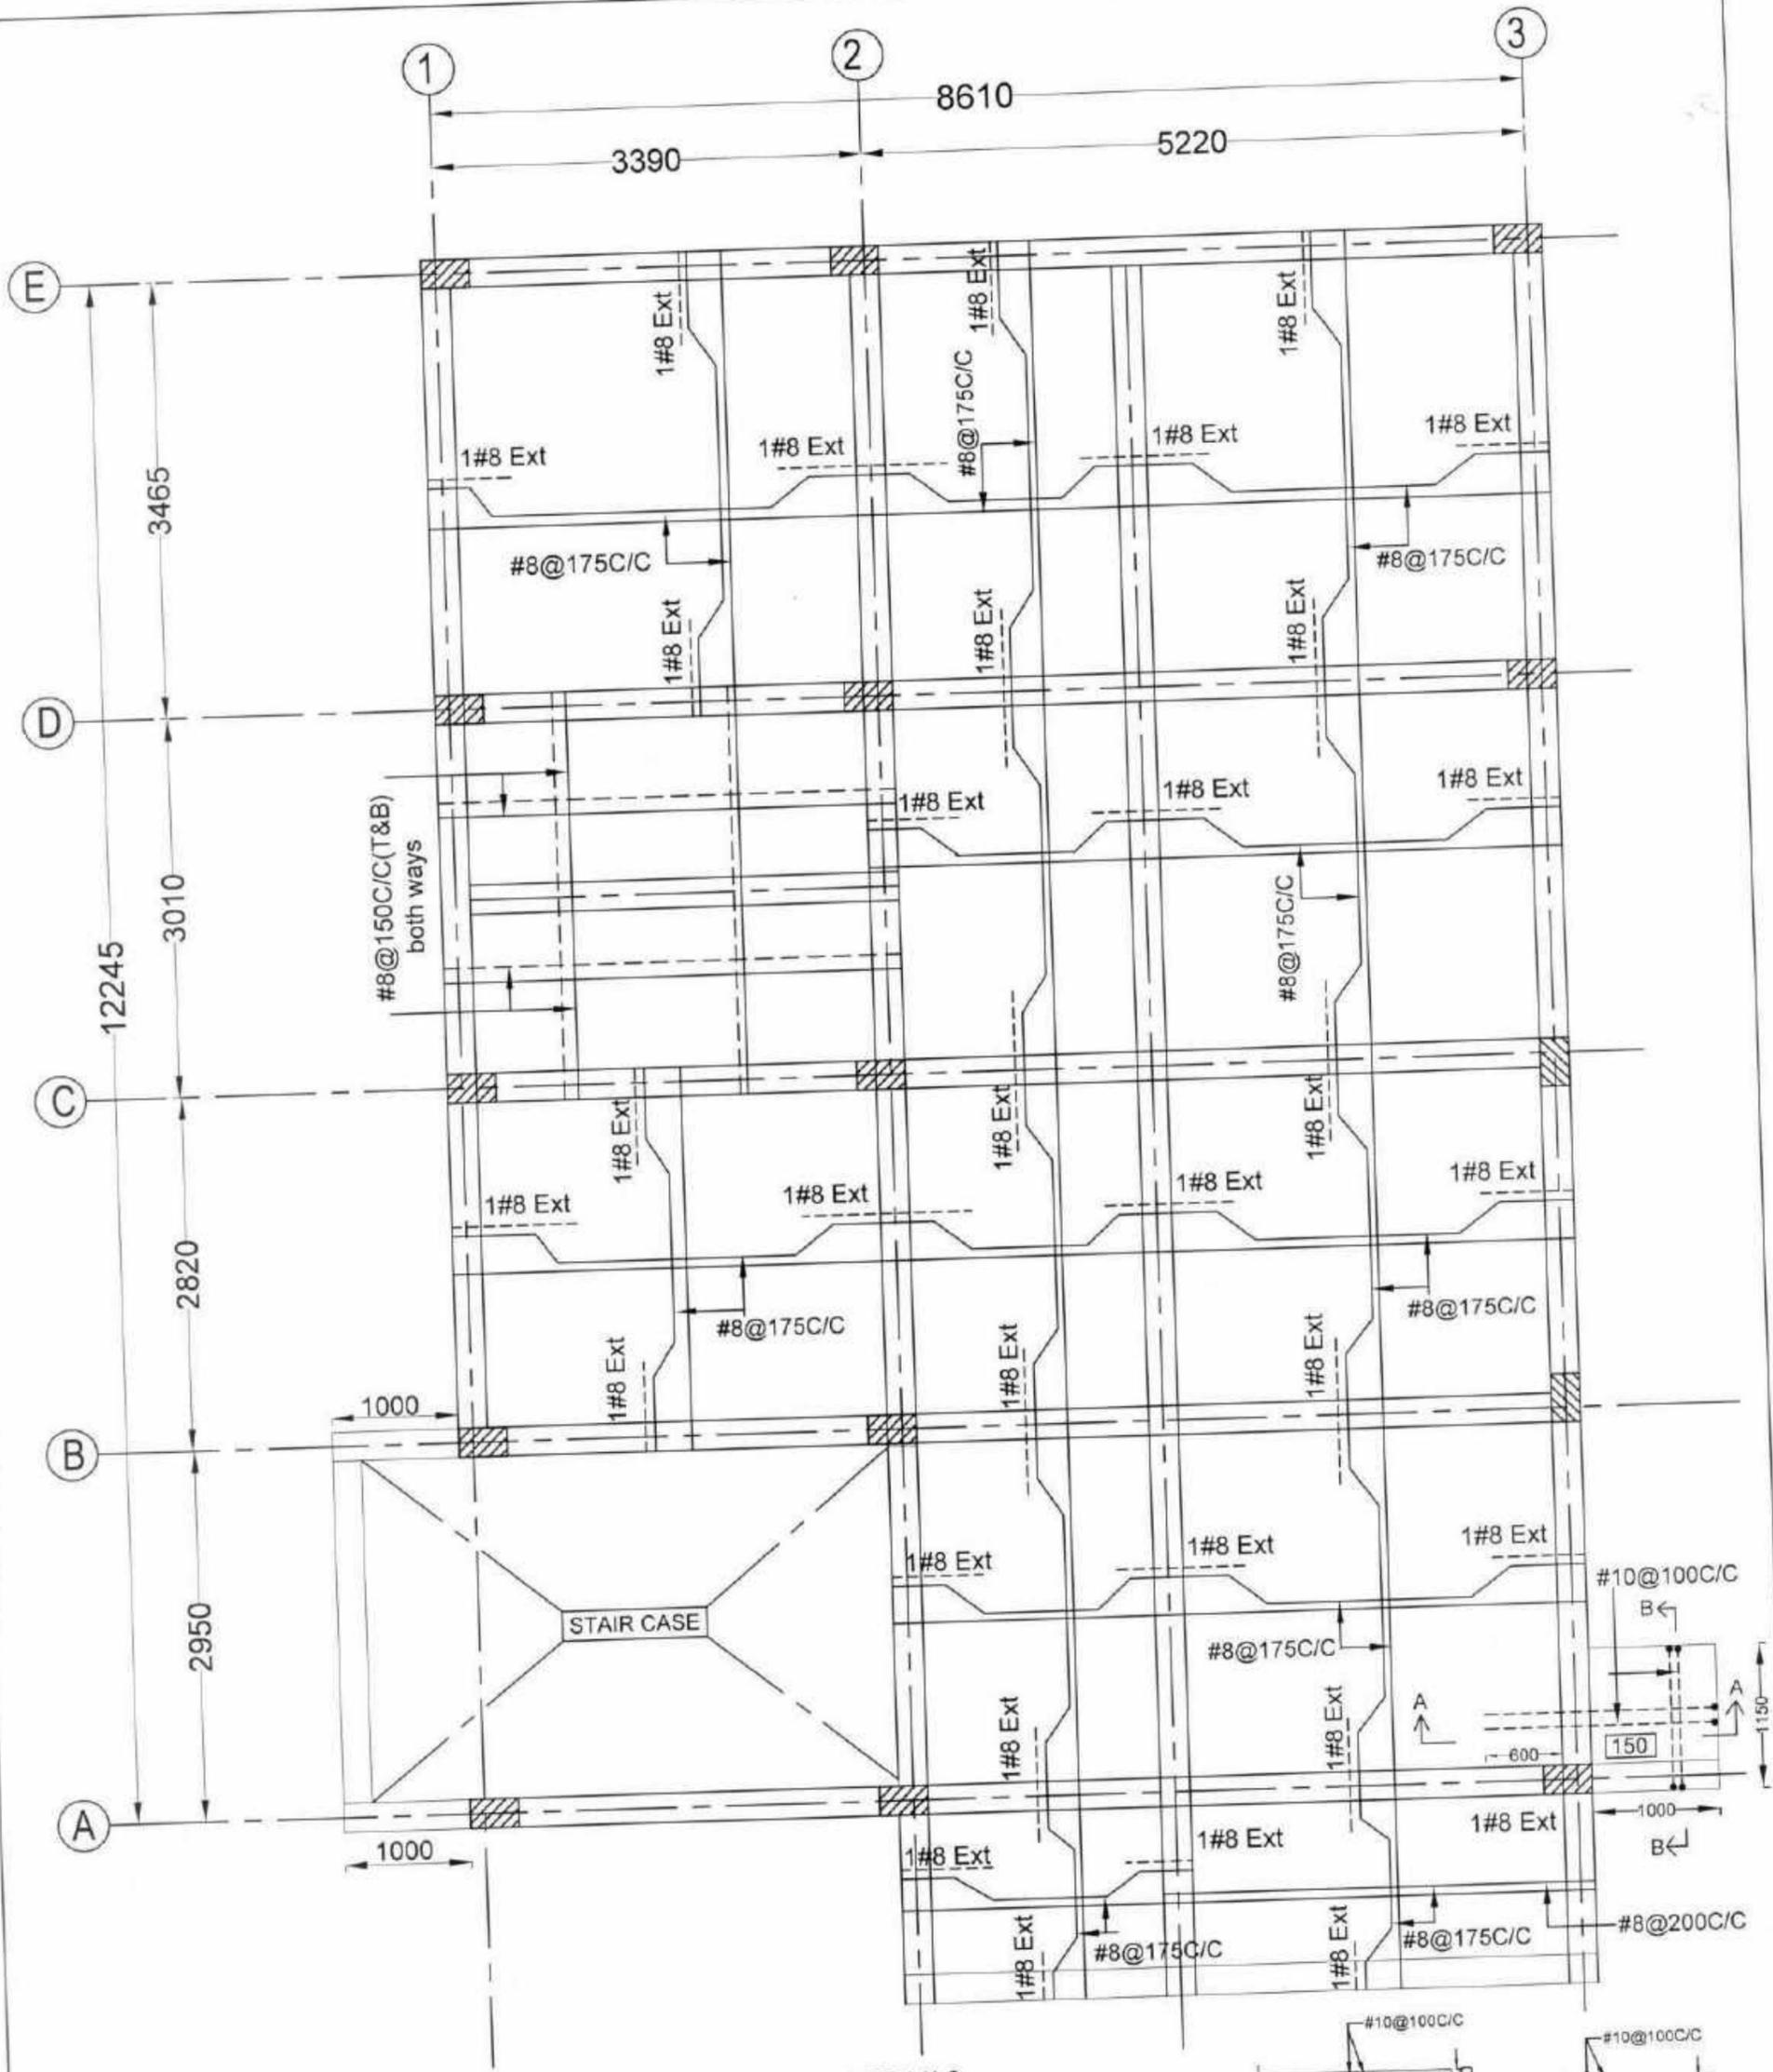

GROUND FLOOR ROOF SLAB DETAILS

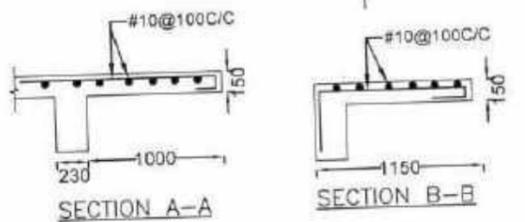

NOTE: All Slabs are 125 mm thickness unless otherwise mentioned


//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

// TRUE COPY //
[Signature]
Dy. Executive Engineer, PR (Designs)

Radial Distance Upto 50 Km From Coast line

Seismic Zone II, Grade of Concrete : M30, Steel Grade : Fe500

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	GROUND FLOOR ROOF SLAB DETAILS
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 09
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	

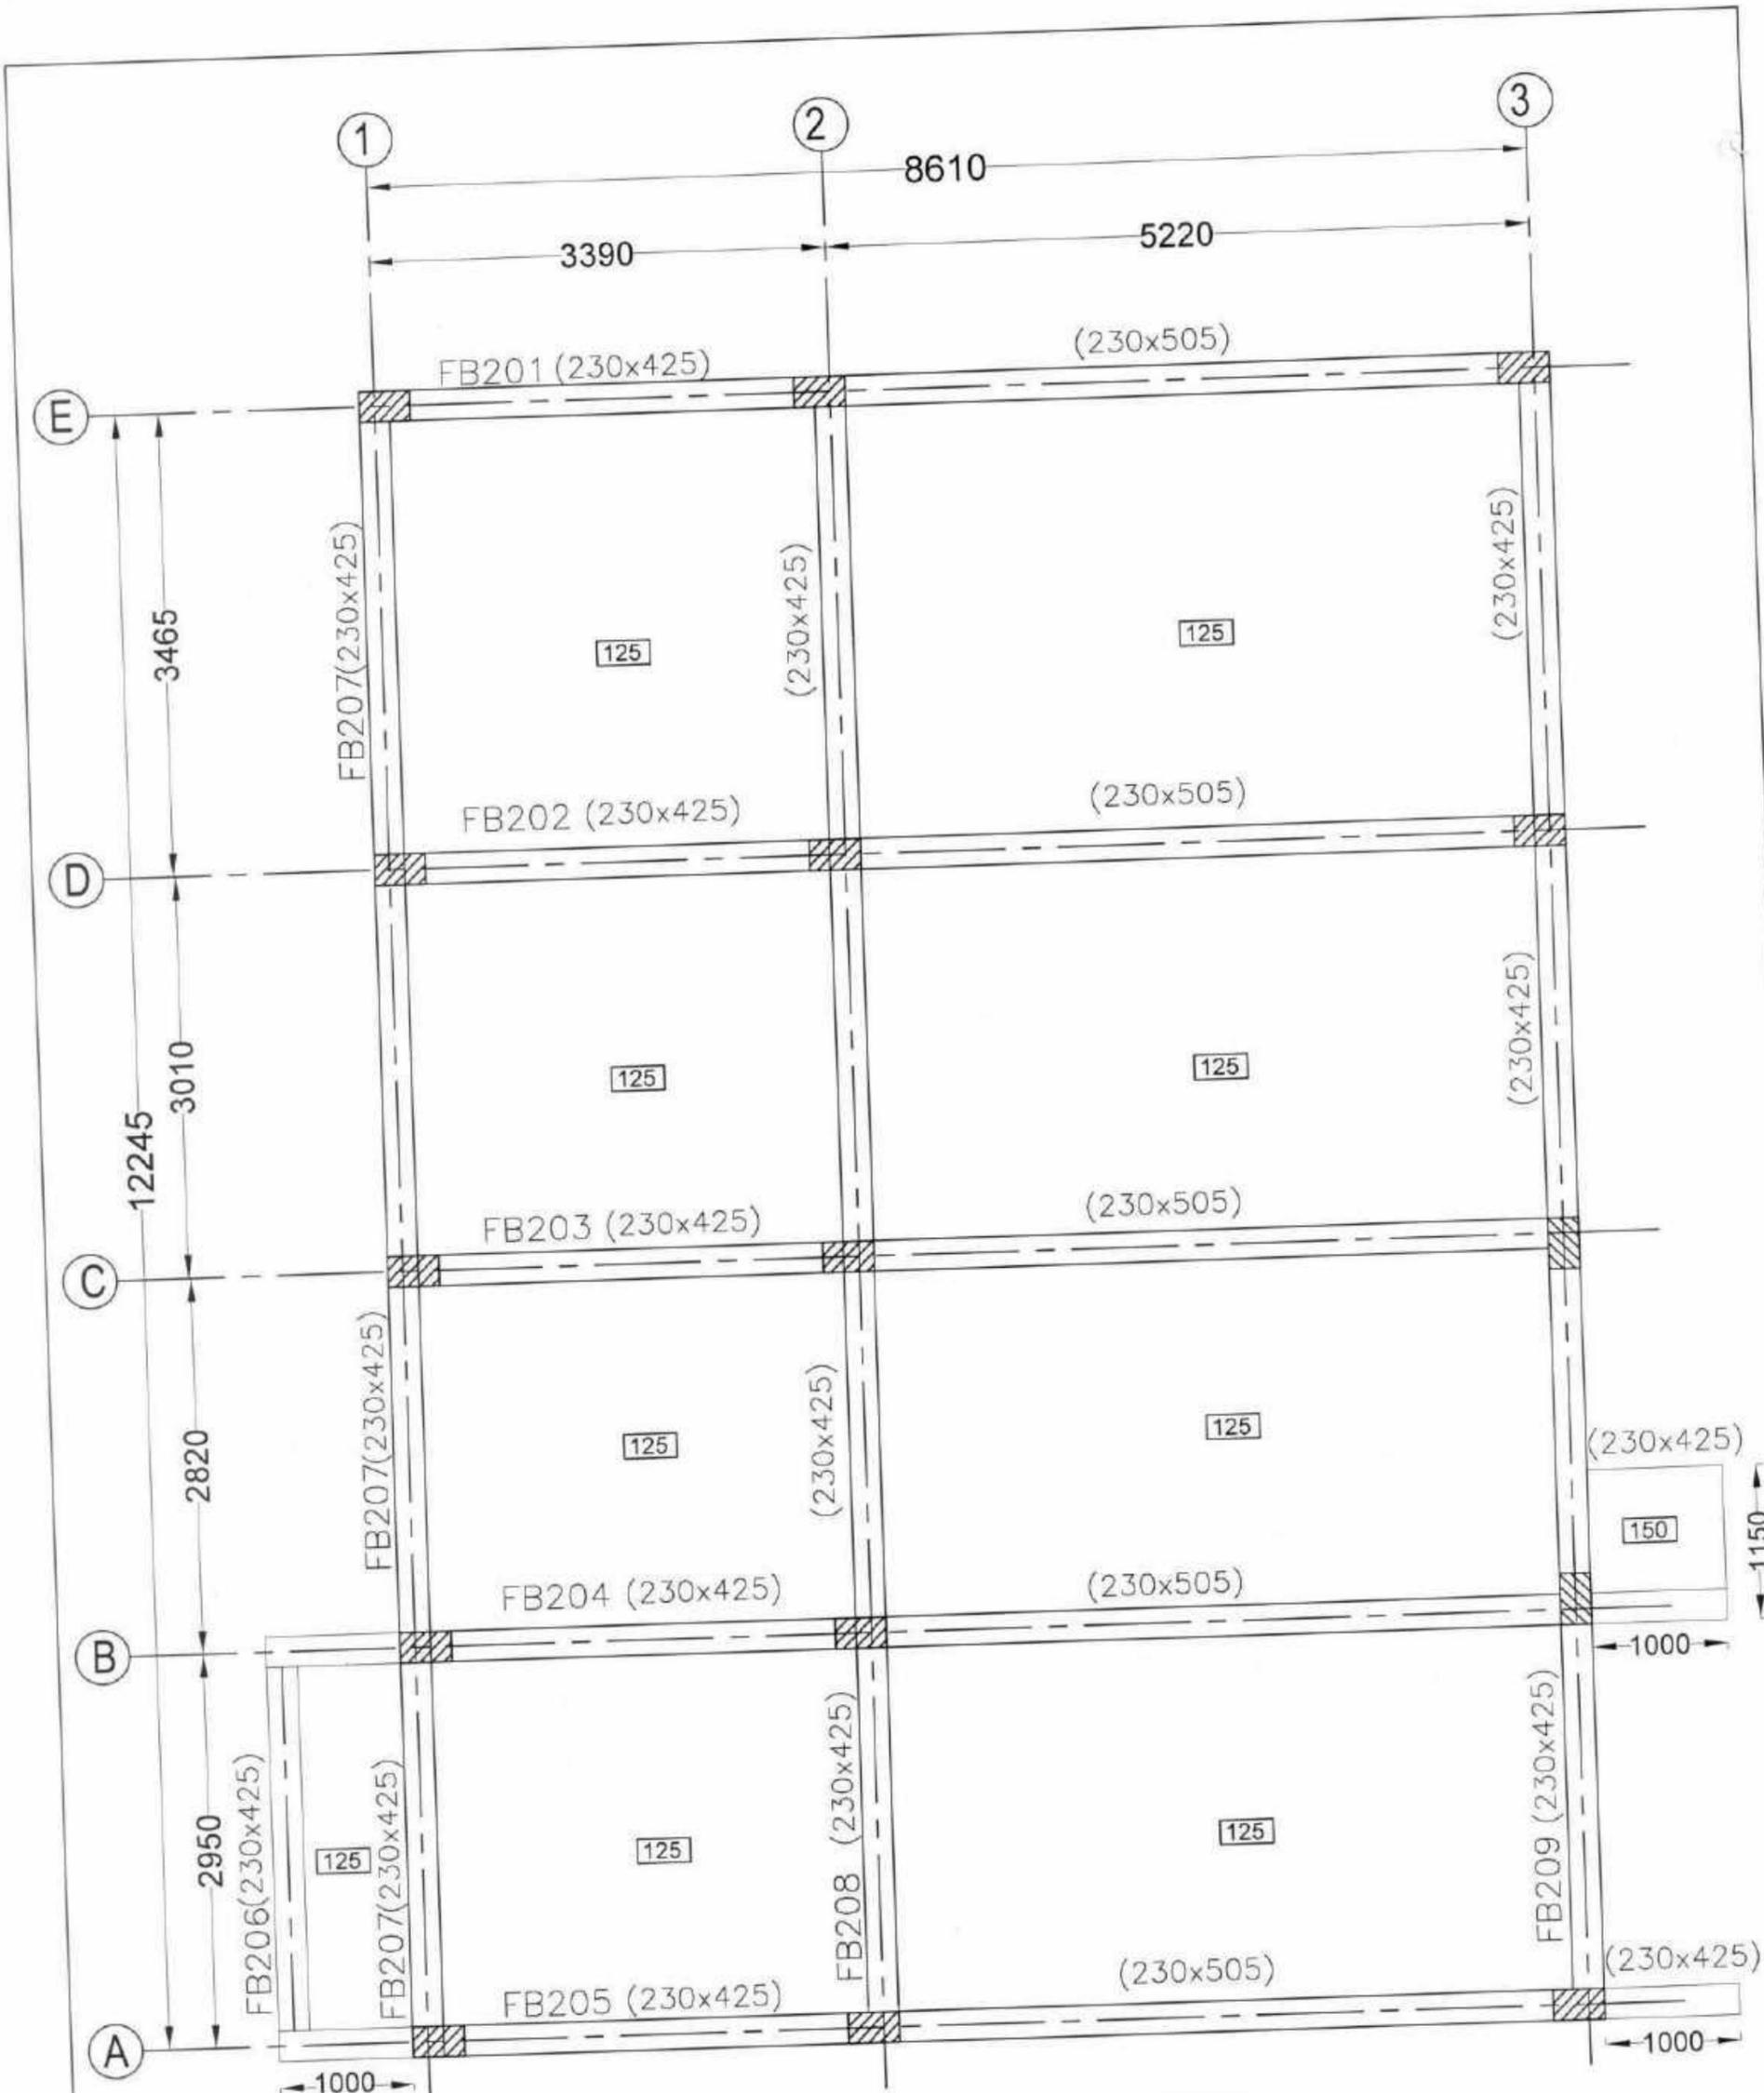

FIRST FLOOR ROOF BEAM LAYOUT

Radial Distance Upto 50 Km From Coast line

//APPROVED//
 Sd/- 04 / 11 / 19
 Chief Engineer,PR II
 Vijayawada.

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

// TRUE COPY //

[Signature]
 Dy. Executive Engineer,PR (Designs)

NAME OF WORK :


CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING

Drg. Title :

FIRST FLOOR ROOF BEAM LAYOUT

Drg.No : PR / Grama Sachivalayam / Z II / M30/ SD / 10

PANCHAYATI RAJ ENGINEERING DEPARTMENT
 VIJAYAWADA.

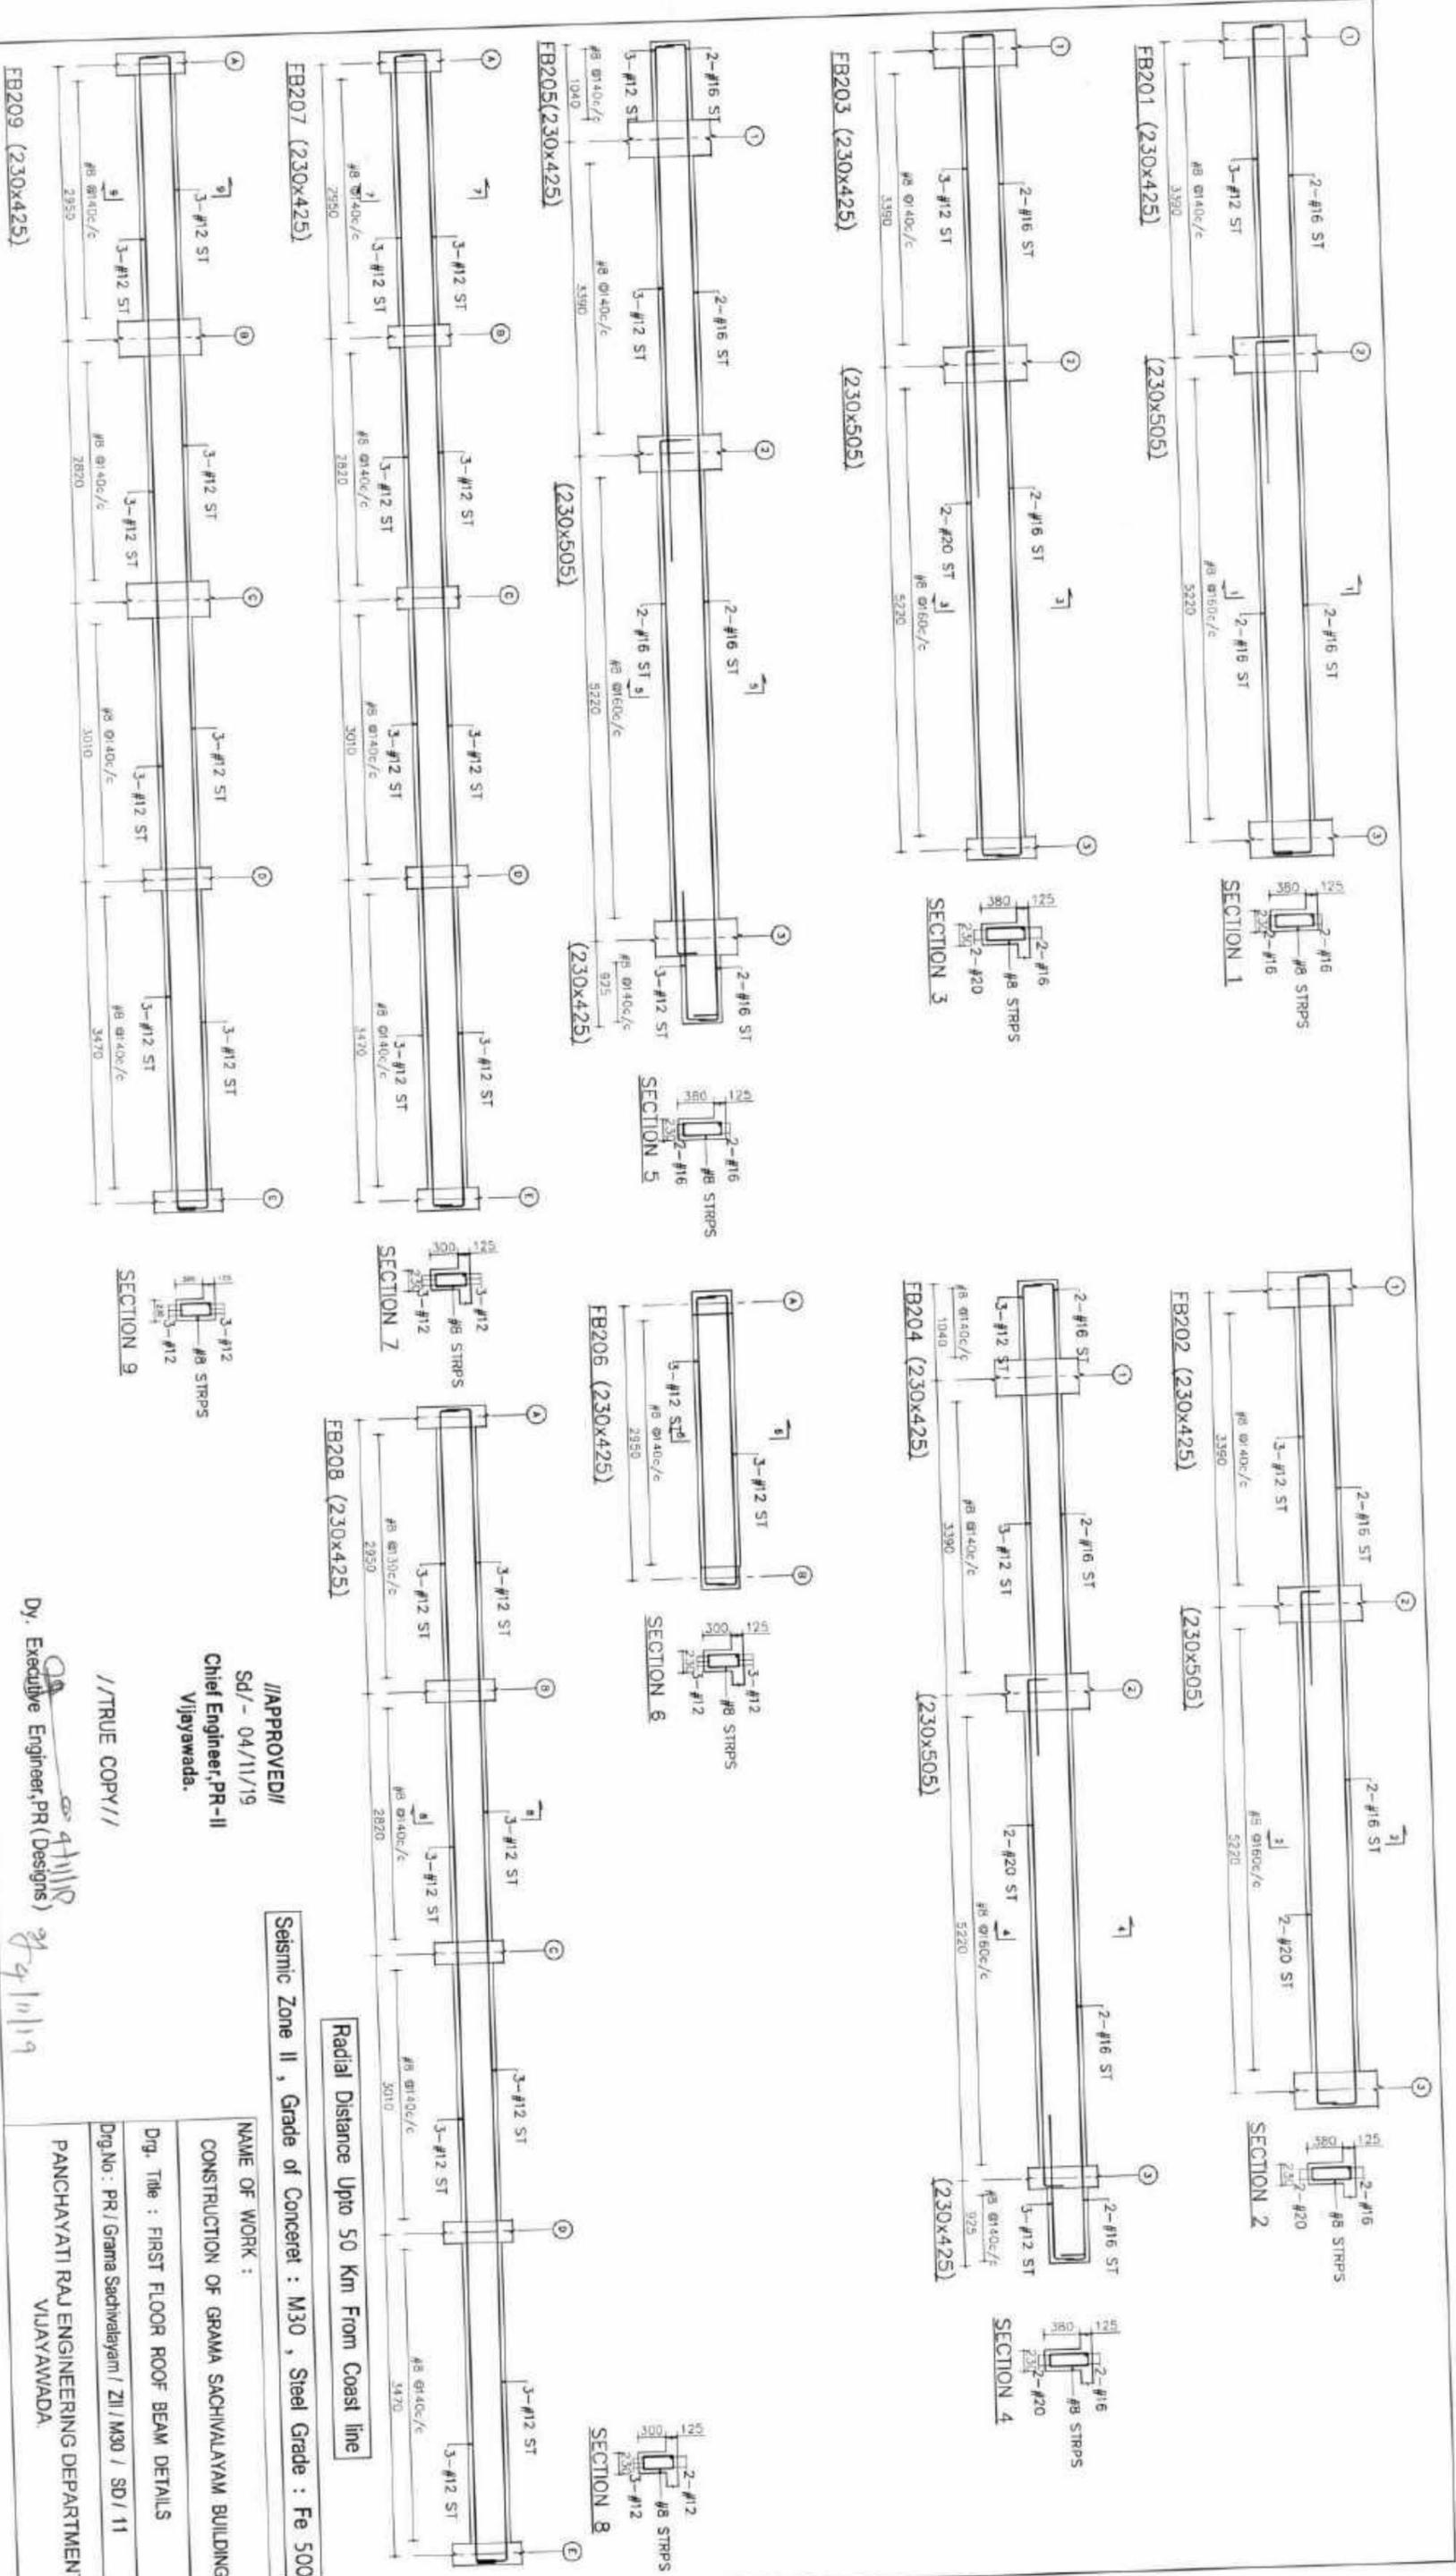


//APPROVED//
 Sd/- 04/11/19
 Chief Engineer, PR-II
 Vijayawada.

//TRUE COPY//
 Dy. Executive Engineer, PR (Designs)
 29/11/19

Seismic Zone II, Grade of Concrete : M30, Steel Grade : Fe 500
 Radial Distance Upto 50 Km From Coast line

NAME OF WORK :
 CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
 Drg. Title : FIRST FLOOR ROOF BEAM DETAILS
 Drg No : PR / Grama Sachivalayam / ZII / M30 / SD / 11
 PANCHAYATI RAJ ENGINEERING DEPARTMENT
 VIJAYAWADA.

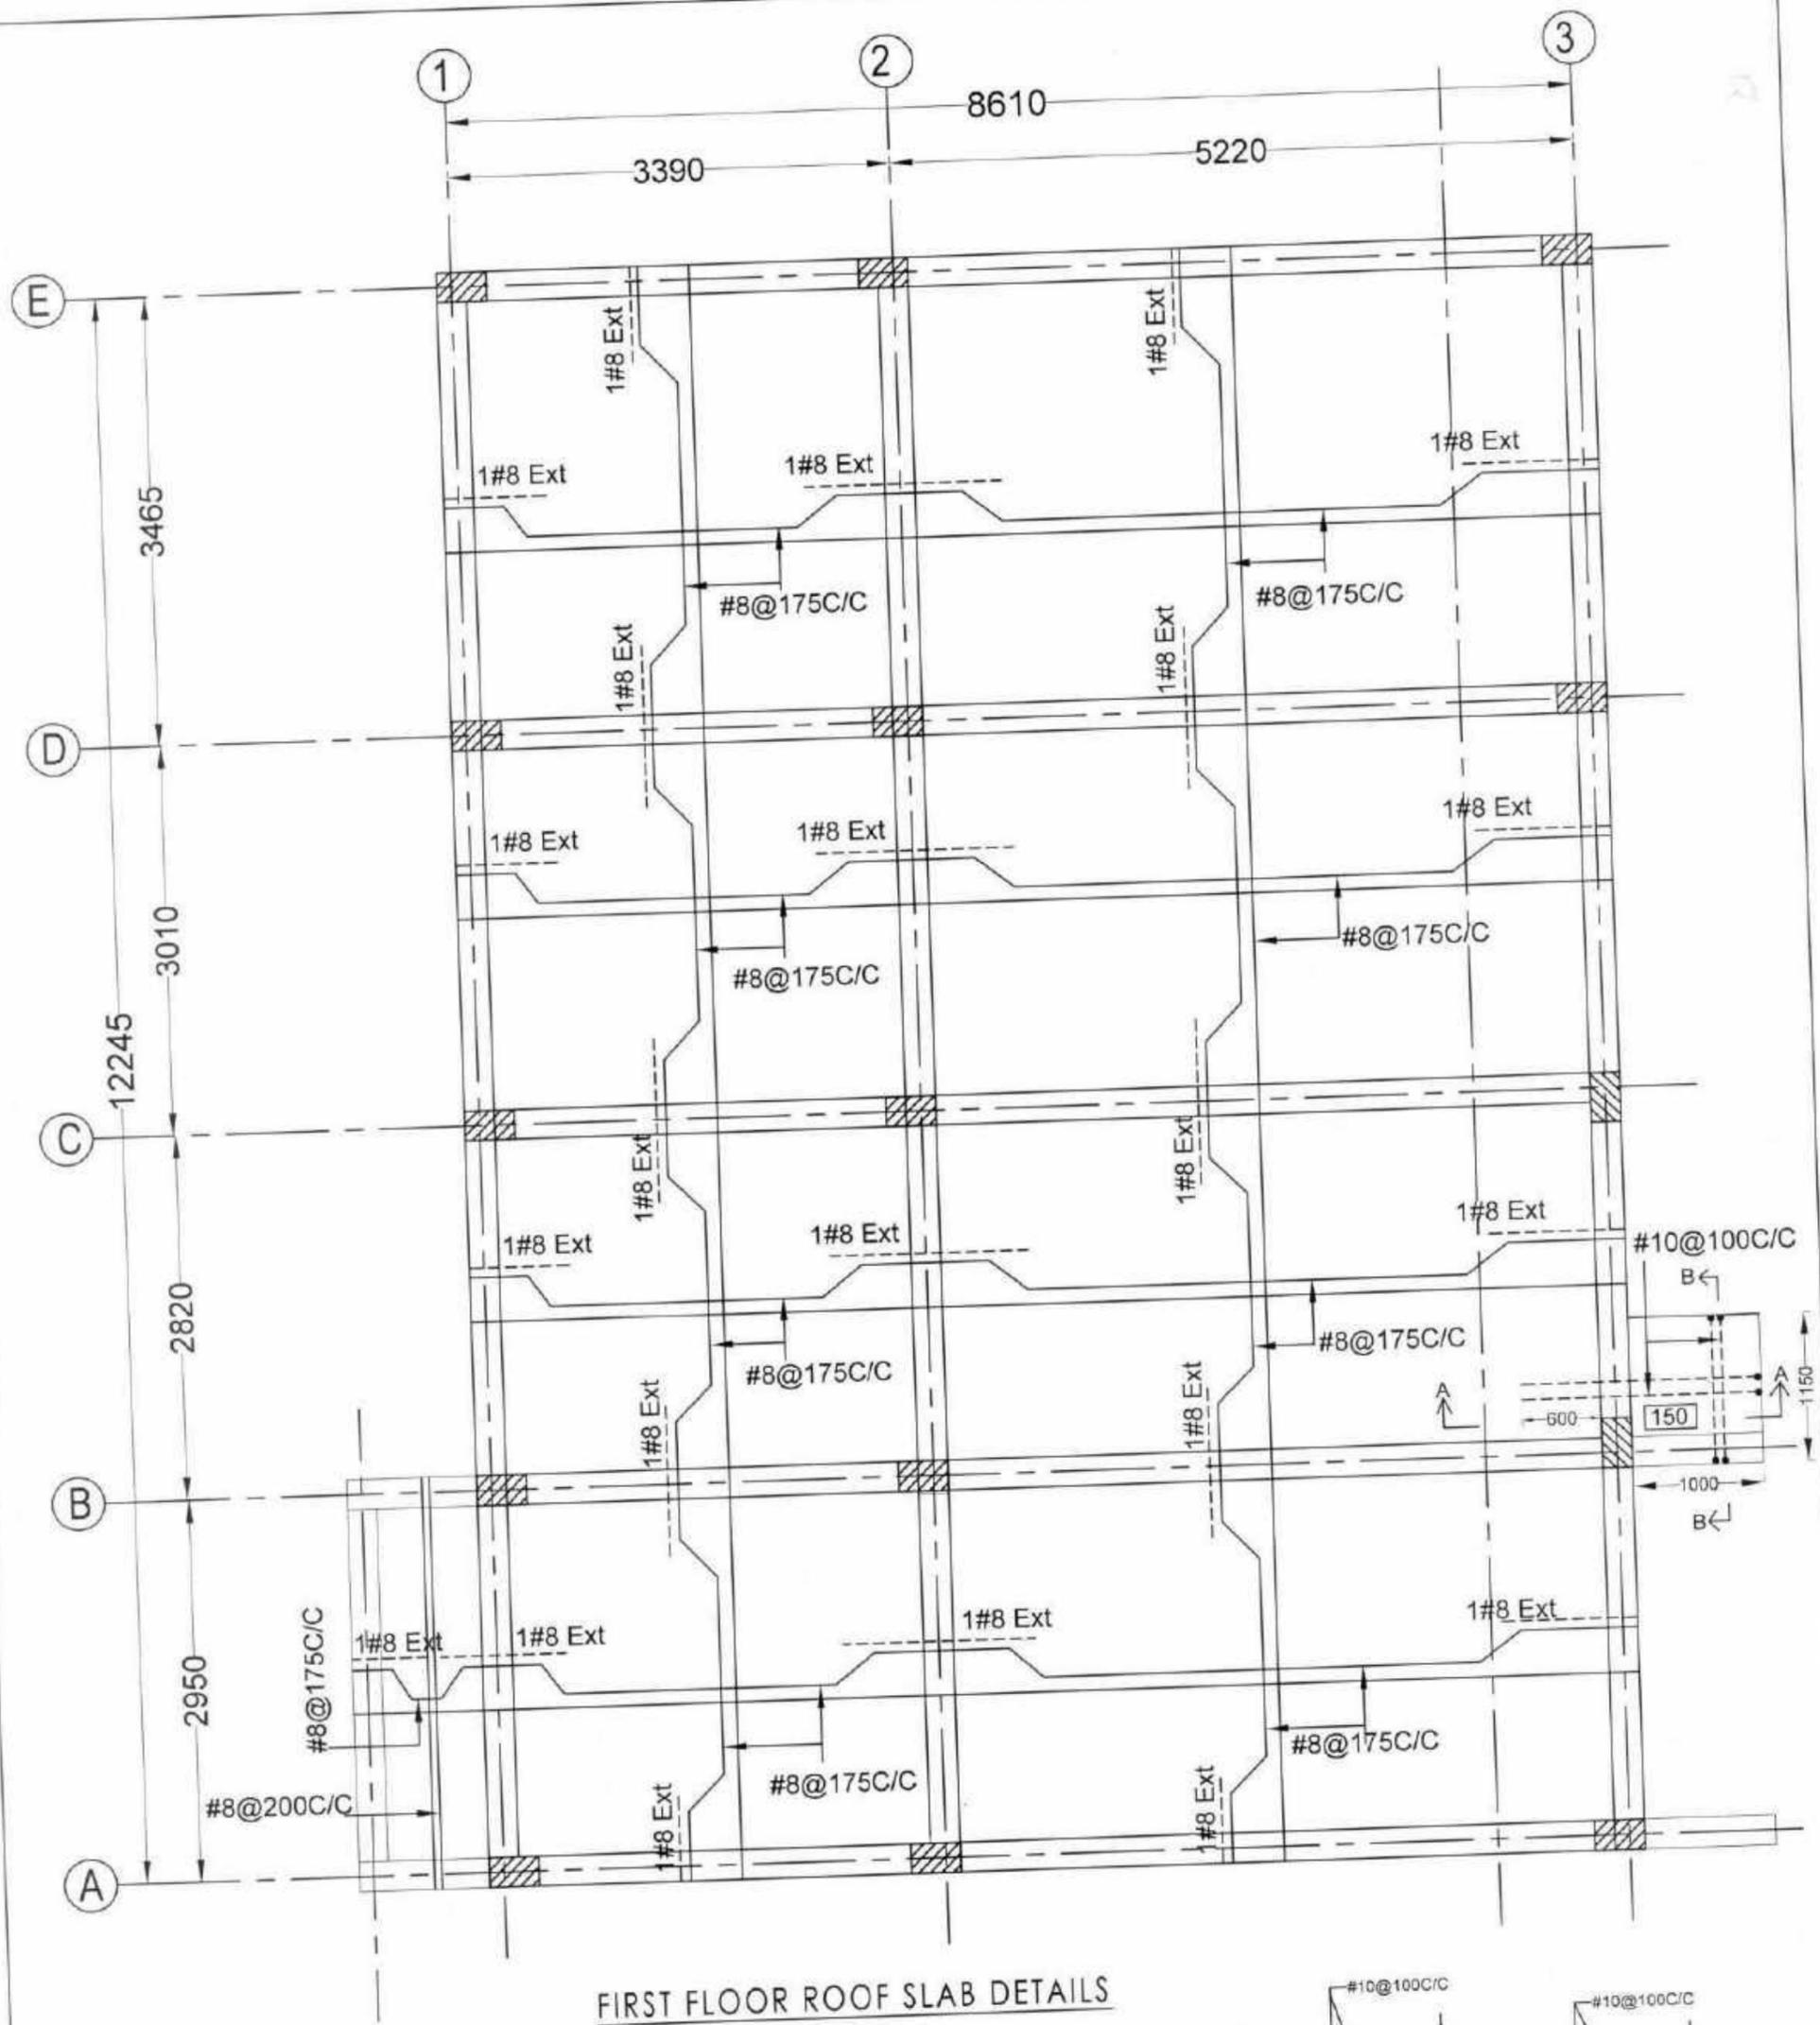

FIRST FLOOR ROOF SLAB DETAILS

NOTE: All Slabs are 125 mm thickness unless otherwise mentioned


//APPROVED//
Sd/- 04 / 11 / 19
Chief Engineer, PR II
Vijayawada.

// TRUE COPY //

Dy. Executive Engineer, PR (Designs)

Radial Distance Upto 50 Km From Coast line

Seismic Zone II , Grade of Concrete : M30, Steel Grade : Fe500

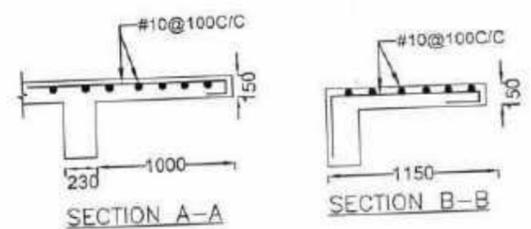

NAME OF WORK :	CONSTRUCTION OF GRAMA SACHIVALAYAM BUILDING
Drg. Title :	FIRST FLOOR ROOF SLAB DETAILS
Drg.No :	PR / Grama Sachivalayam / Z II / M30 / SD / 12
PANCHAYATI RAJ ENGINEERING DEPARTMENT VIJAYAWADA.	